Project code: 2017IE08 Cluster: Coimbatore Report ID: COI/08/DPR

Detailed Project Report (DPR) on Energy Efficient Shot blast machine

M/s Bluemount Castings (P) Ltd., Coimbatore (Tamil Nadu)

Prepared for Bureau of Energy Efficiency (13/GEF-UNIDO-BEE/LSP/14/4562)









...towards global sustainable development



©Bureau of Energy Efficiency, 2018

This DPR has been originally prepared by TERI as a part of 'Capacity Building of LSPs' activity under the GEF-UNIDO-BEE project 'Promoting Energy Efficiency and Renewable Energy in selected MSME clusters in India'.

Suggested Format for Citation

This document may be reproduced in whole or in part and in any form for educational and non-profit purposes without special permission, provided acknowledgement of the source is made. BEE and TERI would appreciate receiving a copy of any publication that uses this document as a source. A suggested format for citation may be as below:

GEF-UNIDO-BEE Project, Bureau of Energy Efficiency, 2018 "Capacity Building of Local Service Providers"

For more information

GEF-UNIDO-BEE PMUEmail: gubpmu@beenet.inBureau of Energy Efficiencypmc@teri.res.in4th Floor, Sewa Bhawan, Sector-1,Website:www.beeindia.gov.inR.K. Puram, New Delhi-110066www.teriin.org

Disclaimer

This document is an output of an exercise undertaken by TERI under the GEF-UNIDO-BEE project's initiative for the benefit of MSME units and is primarily intended to assist the decision making by the management of the intended unit for the proposed technology. While every effort has been made to avoid any mistakes or omissions, GEF, UNIDO, BEE or TERI would not be in any way liable to any person or unit or other entity by reason of any mistake/omission in the document or any decision made upon relying on this document.

Acknowledgement

The Energy and Resources Institute (TERI) places on record its sincere thanks to Global Environment Facility (GEF), United Nations Industrial Development Organization (UNIDO) and Bureau of Energy Efficiency (BEE) for giving opportunity to partner in this prestigious assignment on Capacity Building of Local Service Providers (LSPs) under the GEF-UNIDO-BEE project 'Promoting energy efficiency and renewable energy in selected MSME clusters in India'.

TERI is particularly grateful to Mr Milind Deore, Director, Bureau of Energy Efficiency, Mr Sanjay Shrestha, Industrial Development Officer, Industrial Energy Efficiency Unit, Energy and Climate Branch, UNIDO, Mr Suresh Kennit, National Project Coordinator, UNIDO, Mr Niranjan Rao Deevela, National Technology Coordinator, Energy Efficiency & Renewable Energy in MSMEs, Mr. Sivakumar, UNIDO Cluster Leader, Coimbatore Foundry Cluster, Mr Senthil (Director), M/s Bluemount Castings private limited and Coimbatore Industrial Infrastructure Association (COINDIA) for his support in carrying out the energy audits in the cluster.

Last but not least, the interactions and deliberations with numerous foundry units, industry associations, technology providers and who were directly or indirectly involved throughout the study were exemplary and the whole exercise was thoroughly a rewarding experience for TERI.

The Energy and Resources Institute (TERI) New Delhi



Table of contents

Acknowledgement	1
List of tables	1
List of figures	1
List of abbreviations	1
Executive summary	i
1.0 Details of the unit	1
1.1 Particulars of unit	1
2.0 Energy profile	3
2.1 Process flow diagram	3
2.1.1 Sand preparation plant	3
2.1.2 Core preparation and moulding	3
2.1.3 Melting	3
2.1.4 Knockout and finishing	3
2.2 Details of technology identified	4
2.3 Energy used and brief description of their usage pattern	4
2.4 Energy sources, availability & tariff details	4
2.5 Analysis of electricity consumption	5
3.0 Proposed technology for energy efficiency	7
3.1 Replacement of existing shot blast machine with new EE shot blast machine with IE3 standard premium efficiency motors	7
standard premium efficiency motors	7
standard premium efficiency motors 3.1.1 Background	7 7
standard premium efficiency motors 3.1.1 Background 3.1.2 Observations and analysis	7 7 8
standard premium efficiency motors 3.1.1 Background 3.1.2 Observations and analysis 3.1.3 Recommendation	7 7 8 8
standard premium efficiency motors	7 7 8 8 8
standard premium efficiency motors	7 7 8 8 8 9
standard premium efficiency motors	7 7 8 8 9 9
standard premium efficiency motors	7 7 8 8 9 9 9 9
standard premium efficiency motors	7 7 8 8 9 9 9 9 9
standard premium efficiency motors	7 7 8 8 9 9 9 9 9 9
standard premium efficiency motors	7 7 8 8 9 9 9 9 9 9 9 9
standard premium efficiency motors	7 7 8 8 9 9 9 9 9
 standard premium efficiency motors 3.1.1 Background 3.1.2 Observations and analysis 3.1.3 Recommendation 3.2 Cost benefit analysis 3.3 Pre-training requirements 3.4 Process down time for implementation 3.5 Environmental benefits 3.5.1 CO₂ reduction 3.5.2 Reduction in other pollution parameters (gas, liquid and solid) 4.0 Project financials 4.1 Cost of project and means of finance 4.1.1 Particulars of machinery proposed for the project 	7 7 8 8 9 9 9 9 9 9 9 9 9 11 11
standard premium efficiency motors 3.1.1 Background. 3.1.2 Observations and analysis 3.1.3 Recommendation. 3.2 Cost benefit analysis 3.3 Pre-training requirements 3.4 Process down time for implementation. 3.5 Environmental benefits. 3.5.1 CO ₂ reduction 3.5.2 Reduction in other pollution parameters (gas, liquid and solid). 4.0 Project financials. 4.1 Cost of project and means of finance. 4.1.1 Particulars of machinery proposed for the project. 4.1.2 Means of finance.	7 7 8 8 9 9 9 9 9 9 9 9 9 9 9 11 11 11

4.2.3 NPV and IRR	12
4.3 Marketing & selling arrangement	13
4.4 Risk analysis and mitigation	14
4.5 Sensitivity analysis	14
5.0 Conclusions & recommendations	15
5.1 List of energy conservation measures	15
5.2 Summary of the project	15
5.3 Recommendations	15
6.0 Financing schemes for EE investments for MSME sector	17

Annexures	23
Annexure 1: Budgetary offers / quotations	25
Annexure 2: Instruments used	33

List of tables

Table 1.1: Particulars of the unit	1
Table 2.2: Details of shot blast machine	4
Table 2.3: Energy used and description of use	4
Table 2.4: Energy sources, availability and tariffs	4
Table 2.5: Electricity consumption profile	5
Table 3.1: Connected load details of shot blast machine	8
Table 3.2: Cost benefit analysis for energy savings measure	8
Table 4.1.1: Particulars of machinery proposed for the project	11
Table 4.1.2: Means of finance	11
Table 4.2.1: Assumptions made	11
Table 4.2.2: Payback	12
Table 4.2.3a: NPV and IRR (100% equity)	12
Table 4.2.3b: NPV and IRR (D/E- 70:30)	13
Table 4.2.3c: NPV and IRR (D/E- 50:50)	13
Table 4.3: Marketing & selling arrangements	13
Table 4.4: Risk analysis and mitigation	14
Table 4.5: Sensitivity analysis	14
Table 5.1: Summary of the energy conservation measures	15
Table 5.2: Summary of the project	15
Table 6.1: Major government schemes	17
Table 6.2: BEE's VCFEE and PRGFEE scheme	18
Table 6.3: IREDA's financing guidelines	19
Table 6.4: Major EE financing schemes/initiatives of SIDBI	20
Table 6.5: JBIC-SBI Green Line	21
Table 6.6: Canara bank scheme of EE SME loans	22

List of figures

Figure 2.1.4: Process flow chart	4
Figure 2.5: Demand pattern and energy consumption profile	5
Figure 3.1.2: Trend of the active power consumption	7

List of abbreviations

BEE	Bureau of Energy Efficiency
CO ₂	Carbon Dioxide
D/E	Debt / Equity
DPR	Detailed Project Report
DSCR	Debt Service Coverage Ratio
EE	Energy Efficient
FIs	Financial Institutions
GEF	Global Environmental Facility
GHG	Green House Gas
HP	Horsepower
IDC	Interest Defer Credit
IGDPR	Investment Grade Detailed Project Report
IRR	Internal Rate of Return
Kg	Kilogram
kV	Kilo vault
kVA	kilovolt-ampere
kW	Kilo Watt
kWh	Kilo Watt Hour
LDO	Light Diesel Oil
LSPs	Local Service Providers
MSME	Micro, Small and Medium Enterprises
MT	Metric Tonne
NPV	Net Present Value
O&M	Operation and Maintenance
RE	Renewable Energy
ROI	Return On Investment
Rs	Rupees
SG	Spherulitic Graphite
SPP	Simple Payback Period
TANGENDCO	Tamil Nadu Generation and Distribution Company
TERI	The Energy and Resources Institute
Тое	Tonnes of oil equivalent
UNIDO	United Nations Industrial Development Organization
USP	Unique Selling Proposition
WACC	Weighted Average Cost of Capital

Executive summary

The overall aim of the GEF-UNIDO-BEE project 'Promoting Energy Efficiency (EE) and Renewable Energy (RE) in selected MSME clusters in India' is to develop and promote a market environment for introducing energy efficiency and enhancing the use of renewable energy technologies in process applications in selected energy-intensive MSME clusters in India. This would help in improving the productivity and competitiveness of the MSME units, as well as in reducing the overall carbon emissions and improving the local environment.

Under the GEF-UNIDO-BEE Project, TERI has been entrusted to undertake Capacity building of Local Service Providers (LSPs) to BEE. The scope of work under the project is,

- Organizing 4 one-day training/ capacity building workshops for LSPs in each cluster.
- Development of 10 bankable DPRs for each cluster, based on mapping technology needs with capacities of local technology suppliers/service providers, and also replication potential and applications to banks in each cluster.

Name of the unit M/s Bluemount Castings(P) Ltd. Constitution Private Limited MSME Classification Small 1985 Year of Establishment Address: Registered Office: 159, Mettupalayam Road, Mathampalayam, Coimbatore - 641 019 Industry-sector Foundry Products manufactured Grey Iron & SG Iron Casting of automobile parts, valves and machine tools parts Name(s) of the promoters/directors Mr. Senthil

Brief introduction of the MSME unit

A detailed assessment study was undertaken in the identified area with the use of the sophisticated handheld instruments. Energy consumption pattern and production data were collected to estimate the specific energy consumption of the unit. The unit level baseline of the unit was also estimated using the historical data. The total energy consumption of the unit during last 12 months was 83.2 toe which is equivalent to 72.5 lakh rupees. The total CO_2 emission during this period is estimated to be 793 tonnes. Only electricity was considered for CO_2 emission estimation.

The unit manufactures the SG and Grey iron castings of automobile parts, machine tools and valve parts. The total annual liquid metal production of the unit during 2017-18 is estimated to be 1,615 tonnes and total annual good castings production is around 1,050 tonnes. The major source of energy is electricity, consume in the furnace, motors and lighting.

Accepted/ recommended technology implementation

The recommended technology considered after discussion with the plant personnel for implementation in the unit is given below.



Technology	Annual energy saving Electricity (kWh)	Investment ¹ (Rs lakh)	Monetary savings (Rs lakh/ year)	Simple payback period (Years)	Emission reduction (tonnes of CO ₂)
Replacement of existing shot blast machine with new EE shot blast machine	63,900	18.0	8.53	2.1	52.4

Other benefits

- The proposed project is not expected to bring in any change in process step or operating practices therefore no change expected in the product quality.
- Implementation of the selected technology in the unit may result in reduction in CO₂ emissions.

Cost of project & means of finance

S. No.	Particulars	Unit	100% equity	D/E- 70:30	D/E- 50:50
1	Cost of Project	Rs. In Lakh	18.0	18.0	18.0
2	D/E Ratio	-	-	7:3	1:1
3	Project IRR	%	24.1	18.33	19.96
4	NPV	Rs. In Lakh	6.5	3.64	4.46
5	DSCR	-	-	2.21	3.06



 $^{^{\}scriptscriptstyle 1}$ Investment is including GST of 18%

1.0 Details of the unit

1.1 Particulars of unit

Table 1.1: Particulars of the unit

1	Name of the unit	M/s Bluemount Castings (P) Ltd.	
2	Constitution	Private Limited	
3	Date of incorporation / commencement of	1985	
	business		
4	Factory registration number	CB3133	
5	PCB consent number	1708110392133	
6	Name of the Contact Person	Mr. Sethil (Director)	
7	Mobile / Ph. No	+91-9363144885	
8	Email	bluemountcastings@gmail.com	
9	Factory	159, Mettupalayam Road,	
		Mathampalayam, Coimbatore - 641	019
		1	017
10	Industry / Sector	MSME/Manufacturing 0	Owned
11	Products Manufactured	CI & SGI castings	Owned
12	No of hours of operation/shift	8	
13	No of shifts/ day	02	
14	No of days/year	360	
15	Installed Capacity (liquid metal)	4,200 tonnes per year	
16	Whether the unit is exporting its products	Yes	
	(Yes/ No)		
17	Quality Certification, if any	ISO 9001:2008	



2.0 Energy profile

2.1 Process flow diagram

The major steps of process are mould sand preparation, charge preparation followed by melting, pouring, knockout and finishing. The steps are explained below.

2.1.1 Sand preparation plant

The major equipment installed is sand siever, sand mixer and sand transport belts and elevators. Electricity is used to run all rotary machines in sand preparation plant. Fresh sand is mixed with adhesives in sand mixer then it is pressed in mould casing by pressing machine. In casing some amount of burnt sand is reused with fresh sand.

2.1.2 Core preparation and moulding

For core preparation, fresh sand is used. Cores are baked in LDO fired ovens. After hardening of core it is mounted in mould. In mould preparation fresh and burnt sand is pressed by machines which operate on pneumatic in mould casing. Upper and lower half of mould is assembled together and then it gets ready to pouring.

2.1.3 Melting

Melting of charge is done with help of induction furnace. Induction furnace runs on medium frequency three phase electrical supply. Once melt attained required temperature and metallurgy, the liquid melt is poured into the earlier prepared sand moulds using ladles.

2.1.4 Knockout and finishing

Mould is left to cool for certain time, then it follows to a vibrator with grated surface, it knocks-out the sand and the casting is send for finishing, which involves shot blasting and machining job.

The process flow diagram for major product and steel grade casting produced in the foundry is given in figure 2.1.4.

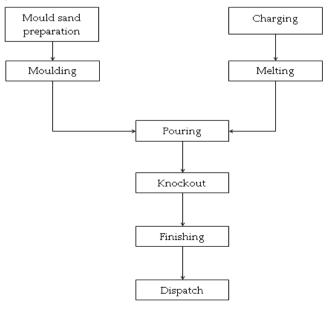




Figure 2.1.4: Process flow chart

2.2 Details of technology identified

The details of the existing shot blast machine installed in the unit are given in Table 2.2.

Table 2.2: Details of shot blast machine

Particulars	Unit	Details
Make	-	Sree Sakhti
Туре	-	Hanger type Monorail
Capacity	kg	500
Batch time	min	3
Operating hours	hrs/day	16
Switching type	-	Manual
Age	years	more than 30
Throughput	tonne/hr	1 (average)

2.3 Energy used and brief description of their usage pattern

The unit uses grid power supplied by Tamil Nadu Generation and Distribution Company (TANGENDCO) under the tariff category HT-I(A). Table 2.3 provides the details of energy uses.

S. No	Energy source	Description of use
1	Electricity	Induction furnace & Motive power for different
		drives in different process sections and utilities

2.4 Energy sources, availability & tariff details

Different energy sources, availability of listed energy types and their respective tariffs are given in table 2.4.

S No	Energy source	Availability	Tariff details
1	Electricity	Supplied by	Tariff category: HT-I(A)
		TANGEDCO	Voltage of supply: 11 kV
			Demand charges: Rs 350/kVA
			Energy charges: Rs 6.35/kWh
			Time of day charges:
			2200-0600: 5% rebate on energy charge
			0600-0900: 20% additional energy charge
			1800-2100: 20% additional energy charge
			PF penalty charges:
			Every 0.01 drop below 0.90, penalty 1% of energy charge
			Every 0.01 drop below 0.85, penalty 1.5% of energy charge

Table 2.4: Energy sources, availability and tariffs



S No	Energy source	Availability	Tariff details
			Every 0.01 drop below 0.75, penalty 2% of energy charge Harmonics penalty:
			If beyond the permissible limits as specified by CEA regulations, 15% of energy charge

2.5 Analysis of electricity consumption

Month	Electricity	Contract	Actual	Power	Demand
	consumption, kWh	Demand, kVA	Demand, kVA	Factor	Charges, Rs.
Dec-17	93,792	632	572	0.93	200,200
Jan-18	69,424	632	572	0.93	200,200
Feb-18	73,736	632	570	0.92	199,500
Mar-18	77,440	632	577	0.92	201,950
Average	78,598	632	573	0.93	200,463
Annual	943,176	-	-	-	-

Table 2.5: Electricity consumption profile

*The plant is procuring power from various sources including DISCOM, open access and wind mills through grid of TANGEDCO. The average cost of electricity has been estimated to be Rs. 7.5 per kWh in consultation with plant personal.

Figure 2.5 presents contract demand, recorded maximum demand and the energy consumption of the unit.

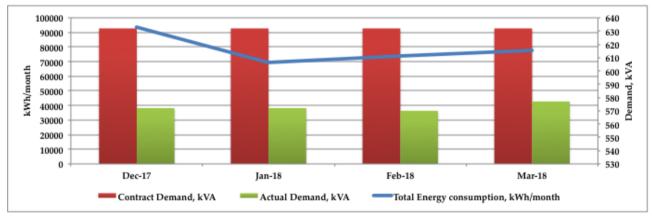


Figure 2.5: Demand pattern and energy consumption profile

The plant is consuming about 966,921 kWh of electricity per year. The total energy consumption of the unit during last 12 months is estimated to be 83.2 toe which is equivalent to 72.5 lakh rupees. The total CO_2 emission during this period is estimated to be 793 tonne. Electricity was considered for CO_2 emission estimation.



3.0 Proposed technology for energy efficiency

Based on the measurements, observations/ findings during detailed assessment study conducted in the unit, the following technology has been identified for energy efficiency improvement. The detail is given below.

3.1 Replacement of existing shot blast machine with new EE shot blast machine with IE3 standard premium efficiency motors

3.1.1 Background

The Bluemount Castings (P) Ltd. is manufacture of SGI and CI castings for general automobile industries, machine tools and valve industries and has installed shot blast machine as a part of finishing process in foundry. The operational parameters of the shot blast machine including the electricity consumption and material charged were measured during the detailed assessment study and historic operating data for past one year is also collected.

3.1.2 Observations and analysis

The power consumption of the shot blast motors is estimated based on the data measured/collected during the field visit in the unit. The unit is charging minimum 350 kg to maximum 400 kg in a batch as per job size and weight. The average time for finishing operation is 20 to 30 min per batch which is very high, based on the data provided by the plant. The measured trend of the active power is shown in figure 3.1.2a.

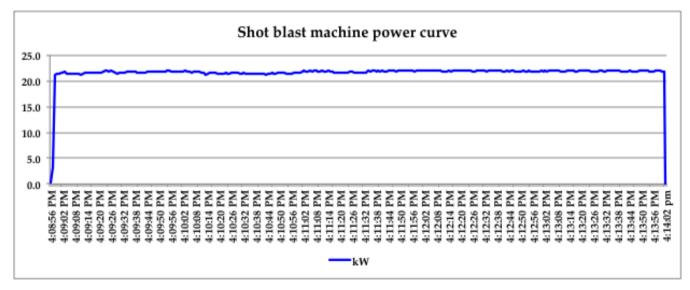


Figure 3.1.2: Trend of the active power consumption

The energy consumption is higher than the consumption in similar categories of motors due to low efficiencies of old and rewinded motors. Therefore, it is recommended to replace the existing shot blast machine with new shot blast machine having standard efficiency motors with new IE3 standard premium efficiency motors. Also, presently connected load of shot blast machine is 50HP including all the motors details of which are given in the table below,



Load	HP	kW
Impeller motor top	15	11.2
Impeller motor bottom	15	11.2
Dust blower	15	11.2
Bucket elevator	3	2.2
Belt drive	2	1.5
Total	50	37.3

Table 3.1:	Connected le	oad details	of shot bla	st machine
------------	--------------	-------------	-------------	------------

3.1.3 Recommendation

The unit may adopt the new shot blast machine with less connected load and IE3 standard motors of to reduce the power consumption. The proposed machine will have IE3 standard motors, which will save at least 5-8% energy w.r.t to existing motors, as existing motors are very old and inefficient.

3.2 Cost benefit analysis

The estimated annual energy savings by replacement of existing shot blast machine with new EE shot blast machine is 63,900 kWh equivalents to a monetary saving of Rs 8.53 lakh. The investment requirement is Rs. 18.0 lakh with a simple payback period of 2.1 years. The detailed calculation of the recommended energy conservation measure is provided in table 3.2.

Particulars	Unit	Old SB	New Shot Blast
		Machine	machine
Connected load	kW	37.3	32.8
Energy consumption in one batch	kWh/batch	9	4.6
No. of batches in one shift of 12 hours	No.s	36	36
No. of batches in one day	No.s	36	36
Energy consumption of shot blast	kWh/day	324	165
Annual energy consumption	kWh/year	113,400	49,500
Energy saving	kWh/year	-	63,900
Monetary saving due to energy saving	Rs. In lakh	-	4.79
Demand	kVA	27	24
Demand saving	kVA/month	-	3
Monetary saving due to demand saving	Rs. In lakh/year	-	0.14
Monetary saving due to labour cost	Rs. In lakh/year	-	3.60
saving			
Total monetary savings	Rs. In lakh/year	-	8.53
Investment required	Rs. In lakh	-	18.0
Simple Payback Period	Years	-	2.1

Table 3.2: Cost benefit analysis for energy savings measure

3.3 Pre-training requirements

The training would be required on regular maintenance practices for new machine.



DPR on Energy Efficient Shot blast machine, (Bluemount Castings (P) Ltd., Coimbatore)

3.4 Process down time for implementation

The estimated process down time required for implementation of recommended measure is estimated to be 2 days.

3.5 Environmental benefits

3.5.1 CO₂ reduction²

Implementation of the selected energy conservation measures in the unit may result in reduction in CO_2 emissions due to reduction in overall energy consumption. The estimated reduction in GHG emission by implementation of the recommended energy conservation measures is 52.4 tonnes of CO_2 per year.

3.5.2 Reduction in other pollution parameters (gas, liquid and solid)

There is not significant impact on the reduction in other pollution parameters including gas, liquid and solid.

 $^{^2}$ Source for emission factor: 2006 IPCC Guidelines for National Greenhouse Gas Inventories & electricity: CO_2 Baseline Database for the Indian Power Sector, user guide version 12.0, May 2017 (CEA)



4.0 Project financials

4.1 Cost of project and means of finance

4.1.1 Particulars of machinery proposed for the project

The particulars of machinery proposed for the project is given in table 4.1.1.

Table 4.1.1:	Particulars	of machinery	proposed for	the project
--------------	-------------	--------------	--------------	-------------

S. No.	Name of machinery	Name of manufacturer, contact person	Basis of selection
	(Model/ specification)		of supplier
1	New energy efficient	Sree Sakhti Equipment's Company,	Reputed supplier
	shot blast machine	Coimbatore , 839/1B, Bethhatapuram	
		Pudur, Karamadai(PO), Coimbatore,	
		Email: sakhti99@vsnl.com	

4.1.2 Means of finance

The means of finance for the project is shown in table 4.1.2.

Table 4.1.2: Means of finance

S. No.	Details	100% equity	D/E- 70:30	D/E- 50:50
1	Additional (Share) Capital	18.0	5.4	9.0
2	Internal Accruals	-	-	-
3	Interest free unsecured loans	-	-	-
4	Term loan proposed (Banks/FIs)	-	12.6	9.0
5	Others	-	-	-
	Total	18.0	18.0	18.0

4.2 Financial statement (project)

4.2.1 Assumptions

The assumptions made are provided in table 4.2.1.

Table 4.2.1: Assumptions made

Details	Unit	100% equity	D/E- 70:30	D/E- 50:50
General about unit				
No of working days	Days		360	
No of shifts per day	Shifts		2	
Annual operating hours	hours/year		5,760	
Installed production capacity	tonnes/year		4,200	
Production in last financial years	tonnes/year		1,615	
Capacity utilization factor	%		38%	
Total cost of the project	Rs. (in Lakh)	18.0	18.0	18.0
Investment without interest defer	Rs. (in Lakh)	18.0	18.0	18.0
credit (IDC)				
Implementation time	Weeks	1	1	1
Interest during the implementation	Rs. in lakhs	-	0.66	0.47
phase				



DPR on Energy Efficient Shot blast machine, (Bluemount Castings (P) Ltd., Coimbatore)

Details	Unit	100% equity	D/E- 70:30	D/E- 50:50
Total investment	Rs. in lakhs	18.0	18.66	18.5
Own funds	Rs. in lakhs	18.0	6.1	9.5
Loan funds (term loan)	Rs. in lakhs	-	12.60	9.0
Loan tenure	Years	-	5.0	5.0
Moratorium period (No EMI	Months	-	6.0	6.0
(interest and principal amount))				
Total repayment period	Months	-	60	60
Interest rate	%	-	10.5%	10.5%
Operation & maintenance costs	%		5.0	
Annual escalation rate of O&M	%		5.0	
Reduction in energy cost	Rs. lakh/year		8.53	
Total saving	Rs. lakh/year		8.53	
Straight line depreciation	%		16.21	
IT depreciation	%		80.00	
Income tax	%		33.99	
Period of cash flow analysis	Years		5.0	

4.2.2 Payback

The simple payback period on the investments made are shown in table 4.2.2.

Details	100% equity	D/E- 70:30	D/E- 50:50
Total project cost (Rs. In lakh)	18.00	18.66	18.47
Cash flow as annual saving (Rs. In lakh/year)	8.53	8.53	8.53
O&M Expenses for first year (Rs. In lakh/year)	0.90	0.93	0.92
Net Cash flow (Rs. In lakh/year)	7.63	7.60	7.61
SPP (months)	28.31	29.48	29.14
Considered (month)	28.30	29.50	29.10

4.2.3 NPV and IRR

The NPV and IRR calculations are shown in table 4.2.3.

Particulars / years	0	1	2	3	4	5
, ,			Rs. in 1	akhs		
Profit after tax	-	4.71	5.37	2.25	2.06	2.00
Depreciation	-	2.92	2.92	2.92	2.92	2.92
Cash outflow	18.00	-	-	-	-	-
Net cash flow	-18.00	7.63	8.29	5.17	4.98	4.92
Discount rate % @WACC	9.30	9.30	9.30	9.30	9.30	9.30
Discount factor	1.00	0.92	0.84	0.77	0.70	0.64
Present value	-18.00	6.98	6.94	3.97	3.50	3.16
Net present value	6.55					
Simple IRR considering regular cash flow	24.12%					

Table 4.2.3a: NPV and IRR (100% equity)



DPR on Energy Efficient Shot blast machine, (Bluemount Castings (P) Ltd., Coimbatore)

Table 4.2.3b: NPV and IRR (D/ E	2-70:30)					
Particulars / years	0	1	2	3	4	5
			Rs. in	lakhs		
Profit after tax	-	3.93	4.94	1.55	1.52	1.64
Depreciation	-	3.03	3.03	3.03	3.03	3.03
Cash outflow	18.66	-	-	-	-	-
Net cash flow	-18.66	6.96	7.97	4.57	4.55	4.67
Discount rate % @ WACC	10.10	10.10	10.10	10.10	10.10	10.10
Discount factor	1.00	0.91	0.83	0.75	0.68	0.62
Present value	-18.66	6.32	6.58	3.43	3.09	2.89
Net present value	3.64					
Simple IRR considering regular	18.33%					
cash flow						

Table 4.2.3b: NPV and IRR (D/E-70:30)

Table 4.2.3c: NPV and IRR (D/E- 50:50)

Particulars / years	0	1	2	3	4	5
			Rs. in	lakhs		
Profit after tax	-	4.15	5.07	1.75	1.68	1.75
Depreciation	-	2.99	2.99	2.99	2.99	2.99
Cash outflow	18.47	-	-	-	-	-
Net cash flow	-18.47	7.15	8.06	4.74	4.67	4.74
Discount rate % @WACC	9.90	9.90	9.90	9.90	9.90	9.90
Discount factor	1.00	0.91	0.83	0.75	0.69	0.63
Present value	-18.47	6.51	6.68	3.58	3.21	2.96
Net present value	4.46					
Simple IRR considering regular cash	19.96 %					
flow						

4.3 Marketing & selling arrangement

The marketing and selling arrangements of the unit are given in table 4.3.

Items	Remarks
Main Markets (locations)	Pan India
Locational advantages	-
Indicate competitors	Other Foundry units
Any USP or specific market strength	-
Whether product has multiple applications	NA
Distribution channels (e.g. direct sales,	Direct sales
retail network, distribution network)	
Marketing team details, if any.	NA

 Table 4.3:
 Marketing & selling arrangements



4.4 Risk analysis and mitigation

The risk analysis and mitigation for the proposed options are given in table 4.4.

Type of risk	Description	Mitigation
Technology	The equipment/technology provided by the supplier may not be of high quality, which may result in underperformance.	The equipment/technology should be procured from standard/reputed vendors only.
Market / Product	Demand of the product manufactured by the unit may change resulting in lower capacity utilization.	Regular vigilance/tab on the market scenario by the SME will help in better understanding of new substitute product. The unit may modify the product line based on the emerging market trend.
Policy/Regulatory	Changes in government regulation/policy related to pollution and taxes & duties can affect the viability of the unit.	Local industrial association may play a role in discussing these issues with the relevant governmental bodies on a regular basis, so that any concerns of the unit are brought to their notice.

Table 4.4: Risk analysis and mitigation

4.5 Sensitivity analysis

A sensitivity analysis has been carried out to ascertain how the project financials would behave in different situations are given in table 4.5.

S. No.	Scenario	D/E ratio	Payback	NPV	IRR	DSCR	ROI
			period	(Rs	(%)		(%)
			(months)	lakh)			
1	10% increase in	100% equity	25.50	8.74	28.75	_	17.45
	estimated savings	70:30	26.50	5.79	22.95	2.40	26.22
	-	50:50	26.20	6.62	24.58	3.33	22.57
2	10% reduction in	100% equity	31.90	4.36	19.34	-	13.53
	estimated savings	70:30	33.20	1.49	13.55	2.02	20.63
		50:50	32.80	2.30	15.18	2.79	17.50
3	10% rise in	70:30	29.60	3.03	17.74	2.17	23.34
	interest rates	50:50	29.20	4.01	19.53	2.99	20.01
4	10% reduction in	70:30	29.40	4.27	18.92	2.25	24.12
	interest rates	50:50	29.10	4.92	20.39	3.12	20.49

Table 4.5: Sensitivity analysis



5.0 Conclusions & recommendations

The IGDPR prepared for the replacement of existing shot blast machine with new EE shot blast machine having IE3 standard motors and less connected load based on the performance assessment study conducted at unit and the acceptance of the unit management. The brief of selected energy conservation measure is given below.

5.1 List of energy conservation measures

The brief summary of the energy conservation measures are given in table 5.1.

Technology	Annual energy saving Electricity (kWh)	Investment (Rs lakh)	Monetary savings (Rs lakh/ year)	Simple payback period (Years)	Emission reduction (tonnes of CO ₂)
Replacement of existing shot blast machine with new EE shot blast machine	63,900	18.0	8.53	2.1	52.4

Table 5.1: Summary of the energy conservation measures

The measure has an estimated investment of 18.0 lakh rupees and can yield a savings of 8.53 lakh rupees per year. The total annual reduction in emission by implementation of recommended measure is estimated to be 52.4 tonnes of CO₂. The financial indicators provided above in the table shows the project is financially viable and technically feasible.

5.2 Summary of the project

The summary of the project is given in table 5.2.

S. No.	Particulars	Unit	100% equity	D/E- 70:30	D/E- 50:50
1	Cost of Project	Rs. In Lakh	18.0	18.0	18.0
2	D/E Ratio	-	-	7:3	1:1
3	Project IRR	%	24.1	18.33	19.96
4	NPV	Rs. In Lakh	6.5	3.64	4.46
5	DSCR	-	-	2.21	3.06

Table 5.2: Summary of the project

5.3 Recommendations

The financial indicators provided above show the project is financially viable and technically feasible. It is recommended that the implementation of the identified the energy conservation measure may be undertaken by the unit.



6.0 Financing schemes for EE investments for MSME sector

Government of India has many schemes to provide concessional finance for EE technologies among MSMEs. Some major government schemes are summarised in table 6.1.

Name of the scheme	Brief Description and key benefits
ZED assessment and certification	Assessment process, fee and subsidy are as follows: Online (e-Platform) self-assessment: Nil fee Desk Top assessment : Rs 10,000 per SME Complete assessment : Rs 80,000 ZED rating per SME; Rs 40,000 for additional ZED defence rating; Rs 40,000 for re-rating The rating costs will include cost of Rs 10,000/- as certification cost by QCI. Subsidy for Micro, Small and Medium Enterprises are 80%, 60% and 50% respectively.
Credit Linked Capital Subsidy Scheme (CLCSS) (2000-ongoing)	15% capital subsidy of cost of eligible plant and machinery / equipment for adoption of proven technologies for approved products / sub-sectors for MSE units subject to ceiling of INR 15 lakhs
Credit Guarantee Fund Scheme for Micro and small Enterprises (in partnership with SIDBI) (2000-ongoing)	This scheme was launched by MoMSME and SIDBI to alleviate the problem of collateral security and enable micro and small scale units to easily adopt new technologies. Under the scheme, collateral free loans up to Rs 1 crore can be provided to micro and small scale units. Additionally, in the event of a failure of the SME unit which availed collateral free credit facilities to discharge its liabilities to the lender, the Guarantee Trust would guarantee the loss incurred by the lender up to 75 / 80/ 85 per cent of the credit facility.
Technology and Quality Up gradation Support to MSMEs (TEQUP) (2010- ongoing)	The benefits available to SMEs under TEQUP include – technical assistance for energy audits, preparation of DPRs and significant capital subsidy on technologies yielding an energy savings of over 15%. The scheme offers a subsidy of 25% of the project cost, subject to a maximum of Rs. 10 lakhs. TEQUP, a scheme under NMCP, focuses on the two important issues in enhancing competitiveness of the SME sector, through EE and Product Quality Certification.
Technology Upgradation Fund Scheme (TUFS) (1999-ongoing)	 Interest subsidy and /or capital subsidy for Textile and Jute Industry only. 1. To facilitate Technology Up gradation of Small Scale (SSE) units in the textile and jute industries. Key features being: Promoter's margin -15%; Subsidy - 15% available on investment in TUF compatible machinery subject to ceiling of Rs 45 lakh; Loan amount - 70% of the cost of the machinery by way of Term Loan

Table 6.1: Major government schemes



Name of the scheme	Brief Description and key benefits
	 Interest rate: Reimbursement of 5% on the interest charged by the lending agency on a project of technology upgradation in conformity with the Scheme Cover under Credit Guarantee Fund Scheme for Micro and Small Enterprises (CGMSE) available
	 2. To enable technology upgradation in micro and small power looms to improve their productivity, quality of products and/ or environmental conditions 20% margin subsidy on investment in TUF compatible specified machinery subject to a ceiling of Rs 60 lakhs or Rs 1crore (whichever is applicable) on subsidy amount to each unit – released directly to the machinery manufacturer.
Tax incentives	 Accelerated depreciation is provided to the customers / users of the energy saving or renewable energy devises under the direct tax laws. Under indirect taxes, specific concessional rates of duty are only available to CFLs and not to all energy efficient products A further waiver of import tariffs and taxes for EE technology imports are dealt on a case to case basis, meaning higher costs for those imported technologies that are not available in the domestic markets at present.

Two financing schemes have been created by Bureau of Energy Efficiency (BEE) under The National Mission for Enhanced Energy Efficiency (NMEEE) for financing of energy efficiency projects - Venture Capital for Energy Efficiency (VCFEE) and Partial Risk Guarantee Fund for Energy Efficiency (PRGFEE). These funds seek to provide appropriate fiscal instruments to supplement the efforts of the government for creation of energy efficiency market. Highlights of these two schemes are provided in the table 6.2.

Table 6.2: BEE's VCFEE and PRGFEE scheme

Venture Capital for Energy Efficiency (VCFEE)	Government buildings and Municipalities in the first phase. A single investment by the fund shall not exceed Rs 2 crore
Partial Risk Guarantee Fund for Energy Efficiency (PRGFEE)	substituting part of the risk of the borrower by granting guarantees ensuring repayment of part of the loan upon a default event.



Venture Capital for • Energy Efficiency (VCFEE) •	This fund is to provide equity capital for energy efficiency projects in Government buildings and Municipalities in the first phase. A single investment by the fund shall not exceed Rs 2 crore Fund shall provide last mile equity support to specific energy efficiency projects, limited to a maximum of 15% of total equity required, through Special Purpose Vehicle (SPV) or Rs 2 crore, whichever is less
• •	partial basis upto the maximum guaranteed amount PFI shall take guarantee from the PRGFEE before disbursement of loan to the borrower. The Guarantee will not exceed Rs 300 lakh per project or 50% of loan amount, whichever is less. Maximum tenure of the guarantee will be 5 years from the date of issue of the guarantee

Indian Renewable Energy Development Agency (IREDA), a non-banking financial institution established by the government also extends financial assistance for setting up projects relating to new and renewable sources of energy and energy efficiency/conservation. The detailed financing guidelines for energy efficiency projects are provided in table 6.3.

Eligible companies who can apply Minimum loan amount	 Private Sector Companies/ firms, Central Public Sector Undertaking (CPSU), State Utilities/ Discoms/ Transcos/ Gencos/ Corporations, Joint Sector Companies which are not loss making. Rs. 50 lakh
Type of projects considered for term loans	 Replacement / retrofit of selected equipment with energy efficient equipment Modification of entire manufacturing processing Recovery of waste heat for power generation
Incentive available	 Rebate in central excise duty Rebate in interest rate on term loan Rebate in prompt payment of loan instalment
Interest rate	 10.60% to 11.90% depending upon the grading of the applicant with prompt payment rebate of 15 bps if payment is made on / before due dates Interest rates are floating and would be reset on commissioning of the project or two years from the date of first disbursement. Thereafter, the rates will be reset after every two years. Rebate of 0.5% in interest rates are available for projects set up in North Eastern States, Sikkim, J&K, Islands, Estuaries. Rebates of 0.5% in interest rates are also available for projects being set up by SC/ST, Women, Ex Servicemen and Handicapped categories involving project cost of upto Rs. 75.00 lakh.
Loan	Upto 70% of the total project cost. Promoter's contribution should be Minimum 30% of the total project cost
Maximum debt	3:1



DPR on Energy Efficient Shot blast machine, (Bluemount Castings (P) Ltd., Coimbatore)

equity ratio	The project cash flow should have a minimum average Debt Service Coverage Ratio of 1.3
Maximum repayment period	12 years with moratorium of maximum 12 months
Procurement procedures	The borrower is required to follow the established market practices for procurement and shall demonstrate that the quality goods and services are being purchased at reasonable and competitive prices. Wherever the loan is sanctioned against international lines of credit such as the World Bank, Asian Development Bank, kfW, etc., the relevant procedures will have to be followed and requisite documents will have to be submitted by the borrower

Small Industries Development Bank of India (SIDBI) has several schemes and focused lines of credit for providing financial assistance for energy efficiency and cleaner production projects for SMEs. Highlights of some of the major financial assistance schemes/projects managed by SIDBI are given in table 6.4.

Table 6.4: Major EE financing schemes/initiatives of SIDBI

End to End Energy Efficiency (4E) Program	 Support for technical /advisory services such as: Detailed Energy Audit Support for implementation Measurement & Verification Financing terms: Terms loans upto 90% Interest rate upto 3% below normal lending rate.
TIFAC-SIDBI Revolving Fund for Technology Innovation (Srijan Scheme)	To support SMEs for up-scaling and commercialization of innovative technology based project at flexible terms and interest rate. Preference accorded to sustainable technologies / products. Soft term loan with an interest of not more than 5%.
Partial Risk Sharing Facility for Energy Efficiency (PRSF) Project (supported by World Bank)	 Sectors covered: Large industries (excluding thermal power plants) SMEs Municipalities (including street lighting) Buildings Coverage: The minimum loan amount Rs 10 lakh and maximum loan amount of Rs 15 crore per project. The extent of guarantee is 75% of the loan amount
JICA-SIDBI Financing Scheme	• The loan is used to provide SMEs with funds necessary to invest in energy-saving equipment (and some medical equipment) in the form of two-step loans through SIDBI or three-step loans through intermediary financial institutions.



	 Project uses an Energy Saving Equipment List approach Equipment/machinery with energy saving potential less than 10% is not eligible. Interest rate: As per credit rating and 1% below the normal lending rate Separate technical assistance component which is used for wetting of loan applications, holding seminars to raise awareness of energy saving among SMEs and to improve the ability of financial institutions to screen loan applications for energy-saving efforts
KfW-SIDBI Financing Scheme	 Coverage a) SMEs for energy efficiency projects b) SMEs and clusters for cleaner production and emission reduction measures, waste management and Common Effluent Treatment Plant (CETP) facilities Interest rate As per credit rating and 1% below the normal lending rate Eligible criteria 3 t CO₂ emission reduction per year per lakh invested List of eligible equipment/technology and potential suppliers developed for guidance

State Bank of India (SBI) has been provided a green line of credit by Japan Bank for International Cooperation (JBIC) for financing of energy efficiency investments. Highlights of the line of credit are given in table 6.5.

Table 6.5: JBIC-SBI Green Line

Key Features

- Amount : USD 90 million
- Repayment Schedule: First repayment on May 30, 2017 and final repayment date May 30, 2025 (equal instalment)

Eligibility Criteria

- Projects contributing to preservation of global environment, i.e. significant reduction of GHG emissions
- Acceptance of JBIC-MRV ('J-MRV") by the project proponent in terms of the numerical effect of the environment preservation. To ensure effective GHG reduction emissions in Green financed projects, JBIC reviews such effects through simple and practical Measurement Reporting Verification (MRV) process both in (a) prior estimation and (b) ex-post monitoring.
- Procurement in line with the "Guidelines for Procurement under Untied Loans by Japan Bank for International Cooperation"



Canara bank has a dedicated scheme for financing EE investment among SME sector as mentioned in table 6.6.

Table 6.6: Canara bank scheme of EE SME loans

Purpose	For acquiring/adopting energy conservation/savings equipment/			
	measures by SMEs			
Eligibility	Units under Small and Medium Enterprises			
	Cost of energy for the unit should constitute not less than 20% of the total			
	cost of production			
	Unit should possess energy audit report issued by an approved energy			
	Consultant/Auditor.			
	Borrowal a/cs-ASCC code S1 or S2 during previous review.			
	Current account holders having dealings exclusively with us satisfactorily			
	for a period of last one year			
Maximum loan	Maximum Rs 100 lakhs in the form of term loan			
Security	Prime: Assets created out of loan			
	Collateral: Upto Rs.5 lakhs - NIL			
	Above Rs.5 lakhs, as determined by the bank			
Repayment	Maximum 5-7 years including moratorium of 6 months			
Guarantee cover	Cover available under CGMSE of CGTMSE available for eligible loans			
Margin	10% of the project cost			
Rate of interest	1% less than the applicable rate			
Upfront fee	1% of the loan			
Insurance cover	Assets acquired and charged as security to Bank to be insured			
Special offer, if any	Grants : Bank provides 25% of the cost of Energy Audit / Consultancy			
	charges with a maximum of Rs 25000/- to the first 100 units on a first come			
	first served basis which is in addition to the grant of Rs 25000/- being			
	provided by IREDA(First 100 units)			

Among the private sector banks in India, Yes Bank is also active in financing of renewable energy and energy efficiency projects. The bank has an MOU with SIDBI for providing funding for EE through PRSF.

Most commercial banks charge interest rate between from 11% to 13% from MSMEs depending upon general criteria such as credit ratings, references, past lending record, balance sheet for last 3 years and so on. Interest rebate is offered for a few customers whose collateral value is around 125% of the loan amount. Further 0.5% concession in interest rate was offered to women entrepreneurs.



Annexures



Annexure 1: Budgetary offers / quotations

Quotation 1: SSEC Foundry Equipments Pvt. Ltd.

SSEC Foundry Equipment Private Limited



12.05.2018

SSECPL : M075:2018 - 2019

MR.NILESH SHEDGE

Dear Sir,

<u>Sub</u>: <u>Offer for Shot Blasting Machine – Reg.</u>

<u>Ref</u> : <u>Your Discussion with our Executive Director</u>

We thank you very much for your Enquiry and the interest you have shown on our products. With reference to your Enquiry We are herewith enclosing our lowest Offer for Shot Blasting Machine as required by you

We trust that we have interpreted your requirement correctly and look forward to receive your valuable comments on the same

Our Representative will contact you shortly to discuss on our offer.

Thanking You and Assuring Our Best Services At All Times.

Your's Faithfully, For SSEC FOUNDRY EQUIPMENT PRIVATE LIMITED.,

AUTHORISED SIGNATORY

Encl : As Above.

DEALERS IN FOUNDRY & OTHER EQUIPMENTS SPARES

★ SHOT BLASTING MACHINES ★ MOULDING MACHINES ★ SAND MIX MULLERS ★ SAND VIBRATORY SIEVES ★ SKIP CHARGERS ★ CORE SAND MIXERS ★ SAND PREPARATION PLANTS ★ MOULD HANDLING SYSTEMS AND MOLTEN METAL HANDLING SYSTEMS ★ SWING FRAME GRINDERS ★ LADLES ★ SAND COLLERS & ALL OTHER FOUNDRY ACCESSORIES ★ CROMPTON MOTORS ★ DRY MIXERS ★ WET MIXERS ★ AUTOMATIC POURING SYSTEMS





01. <u>500 KGS. BATCH CAPACITY CLOSE LOOP SEMI AUTOMATIC</u> <u>SHOT BLASTING MACHINE</u>

Supply of 1 No.500 Kgs batch capacity, Rotary	,	<i>Type : SSEC 1350</i>	
Hanger type, double impeller, Close loop system		SBM	
Semi Automatic Shot blasting machine with Panel		Close loop Semi	
board and Fabric Filter Bag Dust Collection sy		Automatic	
SPECIFICAT		1	
SHOT BLASTING MACHINE / CABIN		RATED / SEMI AUTOMATIC	
Туре	:	SSEC 1350	
Čabin Size	:	1500 x 1800 x 1900	
Hook capacity	:	500 to 1000 Kgs.	
No.of Doors	:	2 Sets.	
No.of Hooks	:	4 Nos.	
Impeller Wheel Dia	:	380 mm - 2 Nos.	
Impeller Motor	:	20 HP x 2 Nos.	
Dust Collector Motor	:	10 HP x 1 No.	
Bucket elevator Motor	:	3 HP x 1 No.	
Hook Spinning Motor	:	1 HP x 1 No.	
Cycle time	:	5 to 7 minutes	
Diameter of job turning circle		1200 mm	
Max. length of parts that can			
be loaded in the Hook	:	1350 mm	
Door open & close	:	Manually	
Shots feeding		Pneumatic cylinder	
Impeller opposite liner	:	Ni hard plates	
Cabin inside lining :		Anti - abrasive rubber sheet	
		AUTOMATIC SYSTEM	
Bucket elevator	:	Electric motor with gear box	
Hook Spinning	:	Electric motor with gear box	
Impeller Wheel	:	Electric motor	
Dust Collector	:	Fabric Filter Bags	
Shots Feeding	:	Pneumatic Cylinder	
Door open & close	:	Manually	
Hook transmitted inside cabin :		Manually	
RICE : Rs. 18,00,000/= EACH		-	

(RUPEES EIGHTEEN LAKHS ONLY)


NOTE : ALL MOTORS ARE CONSIDERED IE 3

DEALERS IN FOUNDRY & OTHER EQUIPMENTS SPARES

★ SHOT BLASTING MACHINES ★ MOULDING MACHINES ★ SAND MIX MULLERS ★ SAND VIBRATORY SIEVES ★ SKIP CHARGERS ★ CORE SAND MIXERS ★ SAND PREPARATION PLANTS ★ MOULD HANDLING SYSTEMS AND MOLTEN METAL HANDLING SYSTEMS ★ SWING FRAME GRINDERS ★ LADLES ★ SAND COLLERS & ALL OTHER FOUNDRY ACCESSORIES ★ CROMPTON MOTORS ★ DRY MIXERS ★ WET MIXERS ★ AUTOMATIC POURING SYSTEMS



h

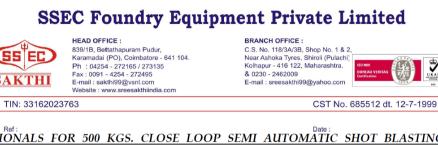

OPTIONALS FOR 500 KGS. CLOSE LOOP SEMI AUTOMATIC SHOT BLASTING MACHINE

OPTION - 1

Cabin lining High Manganese Steel instead of Anti-Abrasive Rubber

<u>PRICE : Rs. 3,30,000/= EACH</u> (RUPEES THREE LAKHS THIRTY THOUSAND ONLY)

OPTION - 2

Double Drum Magnetic Separator at bucket Elevator discharge point Top drum = Dia 332 x 800L Bottom Drum = Dia 200 x 300L

PRICE : Rs. 3,50,000/= EACH

(RUPEES THREE LAKHS FIFTY THOUSAND ONLY)

OPTION - 3

Shot Blasting Machine Loop Automatic Type by providing drag chain [fully automatic]

PRICE : Rs. 5,00,000/= EACH (RUPEES FIVE LAKHS ONLY)

OPTION - 4

Impulse jet type Dust Collector – 60 bags instead of fabric type dust collection system <u>PRICE : Rs. 7,75,000/= EACH</u> (RUPEES SEVEN LAKHS SEVENTY FIVE THOUSAND ONLY)

All Motors will be Crompton Make & Gear Box will be Elecon Make

DEALERS IN FOUNDRY & OTHER EQUIPMENTS SPARES

★ SHOT BLASTING MACHINES ★ MOULDING MACHINES ★ SAND MIX MULLERS ★ SAND VIBRATORY SIEVES ★ SKIP CHARGERS ★ CORE SAND MIXERS ★ SAND PREPARATION PLANTS ★ MOULD HANDLING SYSTEMS AND MOLTEN METAL HANDLING SYSTEMS ★ SWING FRAME GRINDERS ★ LADLES ★ SAND COLLERS & ALL OTHER FOUNDRY ACCESSORIES ★ CROMPTON MOTORS ★ DRY MIXERS ★ WET MIXERS ★ AUTOMATIC POURING SYSTEMS





TERMS AND CONDITIONS.

<u>Make</u>

SSEC. Coimbatore.

<u>Price</u>

Price quoted are for Ex-works Coimbatore exclusive of Packing, Forwarding, insurance, freight and other handling charges. Packing charges will be charged extra @ 3% for full packing and 1% for marginal packing.

Payment Terms

35% advance along with the order and 65% before delivery with taxes and duties against Proforma Invoice before despatch.

Inspection

Machine will be despatched after inspection, at our end, at your cost, prior to despatch.

<u>Delivery</u>

2 to 3 Months time from the date of receipt of your technically and commercially cleared order along with necessary advances. In the light of the fact that we are heavily booked with additional orders, the delivery period quoted is stated in good faith, and we shall not be held responsible for the delay which are due to circumstances beyond our control.

Taxes and Duties

Prices quoted does not include sales tax/general tax, octroi / excise duty and any other local/ municipal/state /central government levies. These will be charged extra to your account as applicable at the time of despatch. Any statutory variation in government levies or additional imposition of government levies shall be to your account.

Erection charges

Will be charged extra @5% from the basic price quoted. To and Fro from Coimbatore to your site. Nominal boarding and lodging charges for our erection personnel and local convenience to be arranged by you.

DEALERS IN FOUNDRY & OTHER EQUIPMENTS SPARES

★ SHOT BLASTING MACHINES ★ MOULDING MACHINES ★ SAND MIX MULLERS ★ SAND VIBRATORY SIEVES ★ SKIP CHARGERS
 ★ CORE SAND MIXERS ★ SAND PREPARATION PLANTS ★ MOULD HANDLING SYSTEMS AND MOLTEN METAL HANDLING SYSTEMS
 ★ SWING FRAME GRINDERS ★ LADLES ★ SAND COLLERS & ALL OTHER FOUNDRY ACCESSORIES ★ CROMPTON MOTORS ★ DRY MIXERS
 ★ WET MIXERS ★ AUTOMATIC POURING SYSTEMS





Cancellation of orders placed by the Purchaser will not be acceptance under normal circumstances. However, if the situation arises, then following cancellation charges will apply on the basis of receipt of intimation of order cancellation at our office from the date of purchase order. a. Within 15 days : Forfeiture of 25% of the advance amount vaid.

a. Within 15 days : b. Within 16 to 45 days : Forfeiture of 25% of the advance amount paid. Forfeiture of 50% of the advance amount paid.

c. 45 days and above :

Forfeiture of 100% of the advance amount paid.

<u>Insurance</u>

To be done by you. Despatch details will be furnished to you to enable you to do the needful in this regard.

Painting and Finishing

Materials will be supplied with 2 coat of Light Blue Paint. If any Painting required after Erection and Commissioning the same has to be done by you on your account.

<u>Guarantee</u>

We undertake to replace/repair at our sole discretion any defective parts that need replacement or repair by reasons of defective workmanship / material brought to our notice within twelve months after despatch.

This guarantee is not valid for fast wearing items like Rubber seals, gaskets trade brought out items like motors, gear boxes, bearings, valves, electrical components, magnets, cylinders, liner Etc., which may form part of our supply. Any such item subjected to the maker's guarantee only.

Validity.

Our offer is valid for a period of thirty days from the date of offer after which is subjected to our confirmation in writing.

For SSEC FOUNDRY EQUIPMENT PRIVATE LIMITED.,

AUTHORISED SIGNATORY

DEALERS IN FOUNDRY & OTHER EQUIPMENTS SPARES

★ SHOT BLASTING MACHINES ★ MOULDING MACHINES ★ SAND MIX MULLERS ★ SAND VIBRATORY SIEVES ★ SKIP CHARGERS ★ CORE SAND MIXERS ★ SAND PREPARATION PLANTS ★ MOULD HANDLING SYSTEMS AND MOLTEN METAL HANDLING SYSTEMS ★ SWING FRAME GRINDERS ★ LADLES ★ SAND COLLERS & ALL OTHER FOUNDRY ACCESSORIES ★ CROMPTON MOTORS ★ DRY MIXERS ★ WET MIXERS ★ AUTOMATIC POURING SYSTEMS



SSEC Foundry Equipment Private Limited				
SAKTHI	HEAD OFFICE : 839/18, Bettathapuram Pudur, Karamadai (PO), Coimbatore - 641 104. Ph : 04254 - 272165 / 273135 Fax : 0091 - 4254 - 272495 E-mail : sakthi99@vsnl.com Website : www.sreesakthiindia.com	BRANCH OFFICE : C. S. No. 118/3A/3B, Shop No. 1 & 2, Near Ashoka Tyres, Shiroli (Pulachi), Kohlapur - 416 122, Maharashtra. & 0230 - 2462009 E-mail : sreesakthi99@yahoo.com		
TIN: 331620237	63	CST No. 685512 dt. 12-7-1999		
Ref :	EXCLUSI	Date : ONS.		

- 1. Foundation and civil work of any nature whatsoever. SSEC will supply the foundation drawing showing the pocket position and loading data at various points. Details civil engineering drawings to suit soil conditions will be prepared by the purchaser. Foundation Pockets and Grouting of Machine.
- 2. Any Steel work embedded in Foundation as also foundation bolts. Buildings, Foundation, Foundation bolts, Civil Foundation and alterations to Foundations.
- 3. Access ladders for pits, pit covers and guard railing around all opening.
- 4. Sumps and pumps required for pumping sub-soil or rain water. Supply of pipes for utilities and piping (Pneumatic/Water)
- 5. Any alteration in the building or roof structure and material required for such purpose. Any modification work in the existing equipment. Area lighting and ventilation for underground pits etc.,
- 6. Local starters for motors and all wiring including earthing materials, power and control cables and conduits between purchaser's mains / MCC / starters and motors, unless offered separately in our quotation. Individual isolators or remote push buttons which are to be located near the motors , unless offered separately in the quotation.
- 7. Power, Compressed Air, Water, oil connection and materials required during erection, commissioning and operation of the machine. Pipework between purchaser's compressed air mains to pneumatic cylinder and control value.
- 8. Supply of first fill of Lubricants / grease / steel shots / Oil to gear box and bearing blocks.

DEALERS IN FOUNDRY & OTHER EQUIPMENTS SPARES

★ SHOT BLASTING MACHINES ★ MOULDING MACHINES ★ SAND MIX MULLERS ★ SAND VIBRATORY SIEVES ★ SKIP CHARGERS
 ★ CORE SAND MIXERS ★ SAND PREPARATION PLANTS ★ MOULD HANDLING SYSTEMS AND MOLTEN METAL HANDLING SYSTEMS
 ★ SWING FRAME GRINDERS ★ LADLES ★ SAND COLLERS & ALL OTHER FOUNDRY ACCESSORIES ★ CROMPTON MOTORS ★ DRY MIXERS
 ★ WET MIXERS ★ AUTOMATIC POURING SYSTEMS





- ^{Ref:} Unloading arrangement at site, storage and moving materials to works spot. Container for removal of oversize rejects and tramp iron. Container for removal of oversize rejects and tramp iron. Trenches and Cable trays for cable and pipe. Bins for collecting dust / iron pieces. Lifting tackles for maintenance purpose.
- 10. Erection casual labour, Mobile Cranes for erection, tools, tackles, welding rods, gas cylinders and other erection material.
- 11. Supply of cables, starter for motors and cable laying from mains to control panel (unless and otherwise specified) and from control panel to individual load points like Motors, limit switches etc., fixed on the machine.
- 12. Production materials. Monorail and hoist for additive lifting. Any other equipment not specifically mentioned in the proposal.
- 13. Erection and Commissioning of the plant and equipment as well as supervision of erection and commissioning unless otherwise stated elsewhere.

For SSEC FOUNDRY EQUIPMENT PRIVATE LIMITED.,

AUTHORISED SIGNATORY

IDEALERS IN FOUNDRY & OTHER EQUIPMENTS SPARES |

★ SHOT BLASTING MACHINES ★ MOULDING MACHINES ★ SAND MIX MULLERS ★ SAND VIBRATORY SIEVES ★ SKIP CHARGERS ★ CORE SAND MIXERS ★ SAND PREPARATION PLANTS ★ MOULD HANDLING SYSTEMS AND MOLTEN METAL HANDLING SYSTEMS ★ SWING FRAME GRINDERS ★ LADLES ★ SAND COLLERS & ALL OTHER FOUNDRY ACCESSORIES ★ CROMPTON MOTORS ★ DRY MIXERS ★ WET MIXERS ★ AUTOMATIC POURING SYSTEMS



Annexure 2: Instruments used

Instruments	Model/ Make	Application	Accuracy
Power analysers	Krykard: ALM 32,	Electrical Parameters	± 0.5%
	Krykard: ALM 10,	Harmonics analysis, power	
		logging	

