

# DETAILED PROJECT REPORT ON VOLTAGE STABILIZER (75 KVA) (GANJAM RICE MILL CLUSTER)



**Bureau of Energy Efficiency**

*Prepared By*



*Reviewed By*



## **VOLTAGE STABILIZERS FOR RICE MILL (75 KVA)**

**GANJAM RICE MILLS CLUSTER**

---

BEE, 2010

Detailed Project Report on Voltage Stabilizer

Rice Mill SME Cluster, Ganjam, Orissa (India)

New Delhi: Bureau of Energy Efficiency;

Detail Project Report No.: **Ganjam/Ricemills/PC/01**

---

**For more information**

Bureau of Energy Efficiency (BEE)

(Ministry of Power, Government of India)

4<sup>th</sup> Floor, Sewa Bhawan

R. K. Puram, New Delhi – 110066

**Telephone** +91-11-26179699

**Fax**+91-11-26178352

**Websites:** [www.bee-india.nic.in](http://www.bee-india.nic.in)

**Email:** [jsood@beenet.in](mailto:jsood@beenet.in)/ [pktiwari@beenet.in](mailto:pktiwari@beenet.in)

## **Acknowledgement**

We are sincerely thankful to the Bureau of Energy Efficiency, Ministry of Power, for giving us the opportunity to implement the BEE SME project in “Ganjam Rice Cluster, Ganjam”. We express our sincere gratitude to all concerned officials for their support and guidance during the conduct of this exercise.

Dr. Ajay Mathur, Director General, BEE

Smt. Abha Shukla, Secretary, BEE

Shri Jitendra Sood, Energy Economist, BEE

Shri Pawan Kumar Tiwari, Advisor (SME), BEE

Shri Rajeev Yadav, Project Economist, BEE

Zenith Energy Services Pvt. Ltd. (ZESPL) is also thankful to Shri Purna Chandra Sahu, President, Shri Santhosh Kumar Sahu, Secretary, Ganjam District Rice Mill Owners Association, Berhampur and to Shri Bibudatta Panigrahi, M/s Aanjeneya Modern Rice Mill for their valuable inputs, co-operation, support and identification of the units for energy use and technology audit studies and facilitating the implementation of BEE SME program in Ganjam Rice Cluster.

We take this opportunity to express our appreciation for the excellent support provided by Rice Unit Owners, Local Service Providers, and Equipment Suppliers for their active involvement and their valuable inputs in making the program successful and in completion of the Detailed Project Report (DPR).

ZESPL is also thankful to all the SME owners, plant in charges and all workers of the SME units for their support during the energy use and technology audit studies and in implementation of the project objectives.

**Zenith Energy Services Private Ltd.**

**Hyderabad**

## Contents

<i>List of Annexure</i>	<i>vii</i>
<i>List of Tables</i>	<i>vii</i>
<i>List of Figures</i>	<i>viii</i>
<i>List of Abbreviation</i>	<i>viii</i>
<i>Executive summary</i>	<i>ix</i>
<i>About BEE'S SME program</i>	<i>xi</i>
<b>1 INTRODUCTION</b>	<b>1</b>
1.1 Brief Introduction about cluster	1
1.1.1 Production process	1
1.2 Energy performance in existing situation	4
1.2.1 Electricity consumption of a typical unit in the cluster	4
1.2.2 Average production by a typical unit in the cluster	4
1.2.3 Specific Energy Consumption	4
1.3 Existing technology/equipment	4
1.3.1 Description of existing technology	4
1.4 Establishing the baseline for the equipment to be changed	5
1.4.1 Electricity consumption	5
1.4.2 Operating efficiency of the existing system	5
1.5 Barriers for adoption of new and energy efficient technology / equipment	6
1.5.1 Technological Barriers	6
1.5.2 Financial Barrier	6
1.5.3 Skilled manpower	6
1.5.4 Other barrier(s)	6
<b>2. EQUIPMENT OPTION FOR ENERGY EFFICIENCY IMPROVEMENT</b>	<b>7</b>
2.1 Detailed description of technology/equipment selected	7
2.1.1 Description of technology	7

2.1.2	Technology /Equipment specifications .....	7
2.1.3	Justification of the technology selected & its suitability.....	8
2.1.4	Superiority over existing technology/equipment .....	8
2.1.5	Availability of the proposed technology/equipment.....	8
2.1.6	Source of technology/equipment for the project.....	8
2.1.7	Service/technology providers .....	9
2.1.8	Terms of sales of the suppliers, etc.....	9
2.1.9	Process down time during implementation.....	9
2.2	Life cycle assessment and risks analysis .....	9
2.3	Suitable unit/plant size the identified equipment.....	9
<b>3.</b>	<b>ECONOMIC BENEFITS OF NEW ENERGY EFFICIENT TECHNOLOGY .....</b>	<b>10</b>
3.1	Technical benefits.....	10
3.1.1	Fuel Saving.....	10
3.1.2	Electricity savings .....	10
3.1.2	Improvement in product quality .....	10
3.1.3	Increase in production.....	10
3.1.4	Reduction in raw material consumption .....	10
3.1.5	Reduction in other losses.....	10
3.2	Monetary benefits .....	10
3.3	Social benefits .....	10
3.3.1	Improvement in working environment in the plant .....	10
3.3.2	Improvement in skill set of workers .....	11
3.4	Environmental benefits .....	11
3.4.1	Reduction in effluent generation .....	11
3.4.2	Reduction in GHG emission such as CO <sub>2</sub> , NO <sub>x</sub> , etc.....	11
3.4.3	Reduction in other emissions like SO <sub>x</sub> .....	11

<b>4.</b>	<b>INSTALLATION OF NEW ENERGY EFFICIENT EQUIPMENT .....</b>	<b>12</b>
4.1	Cost of equipment implementation.....	12
4.1.1	Cost of equipments.....	12
4.1.2	Other costs .....	12
4.2	Arrangement of funds .....	12
4.2.1	Entrepreneur's contribution .....	12
4.2.2	Loan amount.....	12
4.2.3	Terms & conditions of loan .....	12
4.3	Financial indicators .....	12
4.3.1	Cash flow analysis .....	12
4.3.2	Simple payback period.....	13
4.3.3	Net Present Value (NPV) .....	13
4.3.4	Internal rate of return (IRR) .....	13
4.3.5	Return on investment (ROI) .....	13
4.4	Sensitivity analysis in realistic, pessimistic and optimistic scenarios .....	13
4.5	Procurement and implementation schedule .....	13

## **List of Annexure**

Annexure 1: Energy audit and base line establishment .....	14
Annexure 2: Process flow diagram .....	15
Annexure 3: Detail technical assessment report.....	16
Annexure 4 Technical design .....	17
Annexure 5: Detailed Financial Calculations & Analysis .....	18
Annexure 7: Details of technology/equipment and service providers .....	23
Annexure 8: Quotations or Techno-Commercial Bids .....	24

## **List of Table**

Table 1.1: Energy consumption of a typical unit (M/s Sri Ganesh Rice Mill) .....	4
Table 1.2: Specific energy consumption for a typical unit (M/s Sri Ganesh Rice Mill) .....	4
Table 1.3: Electricity consumption in three different units .....	5
Table 2.1: Proposed voltage stabilizer specifications.....	7
Table 4.1: Project cost.....	12
Table 4.2: Sensitivity analysis .....	13



### ***List of Figures***

Figure 1: General Process Flowchart of a Typical Rice Mill Unit .....3

### **Lists of Abbreviations**

- BEE                      - Bureau of Energy Efficiency
- DPR                     - Detailed Project Report
- DSCR                  - Debt Service Coverage Ratio
- GHG                    - Green House Gases
- HP                      - Horse Power
- IRR                     - Internal Rate of Return
- MSME                 - Micro Small and Medium Enterprises
- MoP                    - Ministry of Power
- MoMSME             - Ministry of Micro Small and Medium Enterprises
- NPV                    - Net Present Value
- ROI                     - Return On Investment
- SIDBI                 - Small Industrial Development Bank of India
- TPH                    - Ton Per Hour

## ***EXECUTIVE SUMMARY***

Zenith Energy Services Pvt. Ltd is executing BEE-SME program in Ganjam Rice Mills Cluster, supported by Bureau of Energy Efficiency (BEE) with an overall objective of improving the energy efficiency in cluster units.

Paddy is one of the major crops cultivated in the eastern states especially in the state of Orissa. The Rice comes out of milling of paddy. Hence rice milling is an important activity in the state. There are about 250 rice mills in Ganjam rice mills cluster covering Berhampur, Hinjilicut, Bhanjanagar, and Ganjam areas. The major Energy forms used in the cluster is electricity. Electricity is used for driving the prime movers of elevators, Chaluni, separator, paddy cleaners, Rubber Sheller, and whiteners/cones, drives and for lighting. The cost of energy as a percentage of end product cost (Rice) cost varies anywhere between of 1% to 1.5%.

Based on detailed energy audits conducted in various units of the cluster, the voltage supply is measured to be only 297 volts to 350 volts. About 30% of the units are facing acute low voltage problem due to overloading of electricity board distribution transformers. Due to low voltage, the current drawn by the motors is high due to low voltage and the windings are overheated and the frequent failure of the motors is evidenced. Further, due to low voltage the power consumption of the motors is high.

Voltage stabilizers are an effective solution to voltage fluctuation problems. They are designed to current a wide range of Input Fluctuations to maintain specified output voltage. Installation of proposed technology i.e. voltage stabilizer of 75 KVA capacity would lead to save about 9503 kWh of electricity per year.

The DPR highlights the details of the study conducted for assessing the potential for installation of voltage stabilizer in various unit of cluster, possible electricity savings and its monetary benefit, availability of the technologies/design, local service providers, technical features and proposed equipment specifications, various barriers in implementation, environmental aspects, estimated GHG reductions, capital cost, financial analysis, and schedule of Project Implementation.

This bankable DPR also found eligible for subsidy scheme of MoMSME for “Technology and Quality Upgradation Support to Micro, Small and Medium Enterprises” under “National Manufacturing and Competitiveness Programme”. The key indicators of the DPR including the Project cost, debt equity ratio, monetary benefit and other necessary parameters are given in table:

S.No	Particular	Unit	Value
1	Project cost	` (In lakh)	1.05
2	Electricity saving	kWh/annum	9503
3	Monetary benefit	` (In lakh)	0.40
4	Debit equity ratio	Ratio	3:1
5	Simple payback period	Years	2.63
6	NPV	` (In lakh)	0.40
7	IRR	%age	20.79
8	ROI	%age	24.68
9	DSCR	Ratio	1.51
10	Process down time	Days	2
11	CO <sub>2</sub> reduction	Ton /year	7

**The projected profitability and cash flow statements indicate that the proposed project implementation in the cluster units will be financially viable and technically feasible solution for the cluster.**

## ***ABOUT BEE'S SME PROGRAM***

Bureau of Energy Efficiency (BEE) is implementing a BEE-SME Programme to improve the energy performance in 29 selected SMEs clusters. Ganjam Rice Mills Cluster is one of them. The BEE's SME Programme intends to enhance the energy efficiency awareness by funding/subsidizing need based studies in SME clusters and giving energy conservation recommendations. For addressing the specific problems of these SMEs and enhancing energy efficiency in the clusters, BEE will be focusing on energy efficiency, energy conservation and technology up-gradation through studies and pilot projects in these SMEs clusters.

***Major activities in the BEE -SME program are furnished below:***

### ***Activity 1: Energy use and technology audit***

The energy use technology studies would provide information on technology status, best operating practices, gaps in skills and knowledge on energy conservation opportunities, energy saving potential and new energy efficient technologies, etc for each of the sub sector in SMEs.

### ***Activity 2: Capacity building of stake holders in cluster on energy efficiency***

In most of the cases SME entrepreneurs are dependent on the locally available technologies, service providers for various reasons. To address this issue BEE has also undertaken capacity building of local service providers and entrepreneurs/ Managers of SMEs on energy efficiency improvement in their units as well as clusters. The local service providers will be trained in order to be able to provide the local services in setting up of energy efficiency projects in the clusters

### ***Activity 3: Implementation of energy efficiency measures***

To implement the technology up-gradation project in the clusters, BEE has proposed to prepare the technology based detailed project reports (DPRs) for a minimum of five technologies in three capacities for each technology.

### ***Activity 4: Facilitation of innovative financing mechanisms for implementation of energy efficiency projects***

The objective of this activity is to facilitate the uptake of energy efficiency measures through innovative financing mechanisms without creating market distortion

## **1 INTRODUCTION**

### **1.1 Brief Introduction about cluster**

Paddy is one of the major crops cultivated in the eastern states especially in the state of Orissa. The Rice comes out of milling of paddy. Hence rice milling is an important activity in the state. There are about 250 rice mills in Ganjam rice mills cluster covering Berhampur, Hinjilicut, Bhanjanagar, and Ganjam areas. The major Energy forms used in the cluster is grid electricity. Electricity is used for driving the prime movers of elevators, Chaluni, separator, paddy cleaners, Rubber Sheller, and whiteners/cones, drives and for lighting. The cost of energy as a percentage of end product cost (Rice) cost varies anywhere between 1% and 1.5%.

#### **1.1.1 Production process**

##### ***Pre-Cleaner/ Paddy Cleaner***

Paddy cleaner is a most essential equipment in a rice mill and separates all the impurities like dust, straw, sand, clay and heavy particles of even and uneven sizes from paddy before the paddy is processed. The clean paddy sent to the rubber roll sheller to process further. The advantages with the paddy cleaner are it increases the life of rubber rollers and the percentage of oil in bran.

The function of the dust blower is to remove the dust from paddy through the pipeline connected to the paddy cleaner. This equipment is recommended for installation in conventional rice mills, also to get the same advantages as of modern rice mills. If this are not removed prior to shelling the efficiency of the rubber Sheller and the milling recovery is reduced.

The pre-cleaners separate three groups of materials:

- The first separation is done by scalping or removing the objects that are larger than the grain. Either a flat oscillating screen or a rotary drum screen that allows the grain to pass through but retains straw.
- The second separation retains the grains but allows broken grains, small stones and weed seeds to pass through. Aspirator is installed to remove the dust and light empty grains

### ***Rubber Sheller***

The objective of a hulling/de husking operation is to remove the husk from the paddy grain with a minimum of damage to the bran layer and, if possible, without breaking the brown rice grain. Since, the structure of the paddy grain makes it necessary to apply friction to the grain surface to remove the husk; it leads to breaking of some of the rice.

The paddy is fed into the center of the machine through a small hopper. A vertically adjustable cylindrical sleeve regulates the capacity and equal distribution of the paddy over the entire surface of the rotating disc, paddy is forced between the two discs ( rubber Sheller)and as a result of pressure and friction most of the paddy is de husked (hulled), where husk and brown rice are separated.

### ***Separator***

The output from the huller is a mixture of brown rice, husk, broken paddy etc. The huller aspirator removes the lighter material such as husk, bran and very small broken rice. The remainder passes onto the paddy separator where the unshelled paddy rice is separated from the brown rice. The amount of paddy present depends on the efficiency of the husker, and normally less than 10%. Paddy separators work by making use of the differences in specific gravity, buoyancy, and size between paddy and brown rice. Paddy rice has a lower specific gravity, higher buoyancy, and is physically bigger, longer and wider than brown rice

The compartment type of paddy separator uses the difference in specific gravity and the buoyancy to separate paddy and brown rice. When paddy and brown rice move over an inclined plane, they move at different speeds depending on their specific gravity, their shape and contact area, smoothness of inclined surface and the co-efficient of sliding friction. Brown grains are smaller, heavier, rounder, and smoother and will slide faster than paddy grains. The processing capacity of the compartment separator is dependent on the compartment area. For a 1.5 ton/hr capacity rice mill, a 45-compartment separator made up of 15 compartments on each of three decks is used.

### ***Whitening and Polishing***


In the process of whitening, the skin and bran layer of the brown rice are removed. During polishing of the whitened rice, the bran particles still sticking to the surface of the rice are removed and the surface of the rice is slightly polished to give it a glazed appearance. For further whitening if required as per the market demand or for export market, the polished rice is further processed in the silky machine for additional polishing.

**Rice grader**

After polishing, the white rice is separated into head rice and, large and small broken rice by a sifter. Head rice is normally classified as kernels, which are 75-80% or more of a whole kernel. The sifter is made up of a series of oscillating or cylindrical screens through which the rice passes. The output from the bottom screen is the very fine broken tips and is called the “brewers”.

**Elevators**

The elevator used at different stages of rice milling for transferring paddy, brown rice and white rice during the milling process

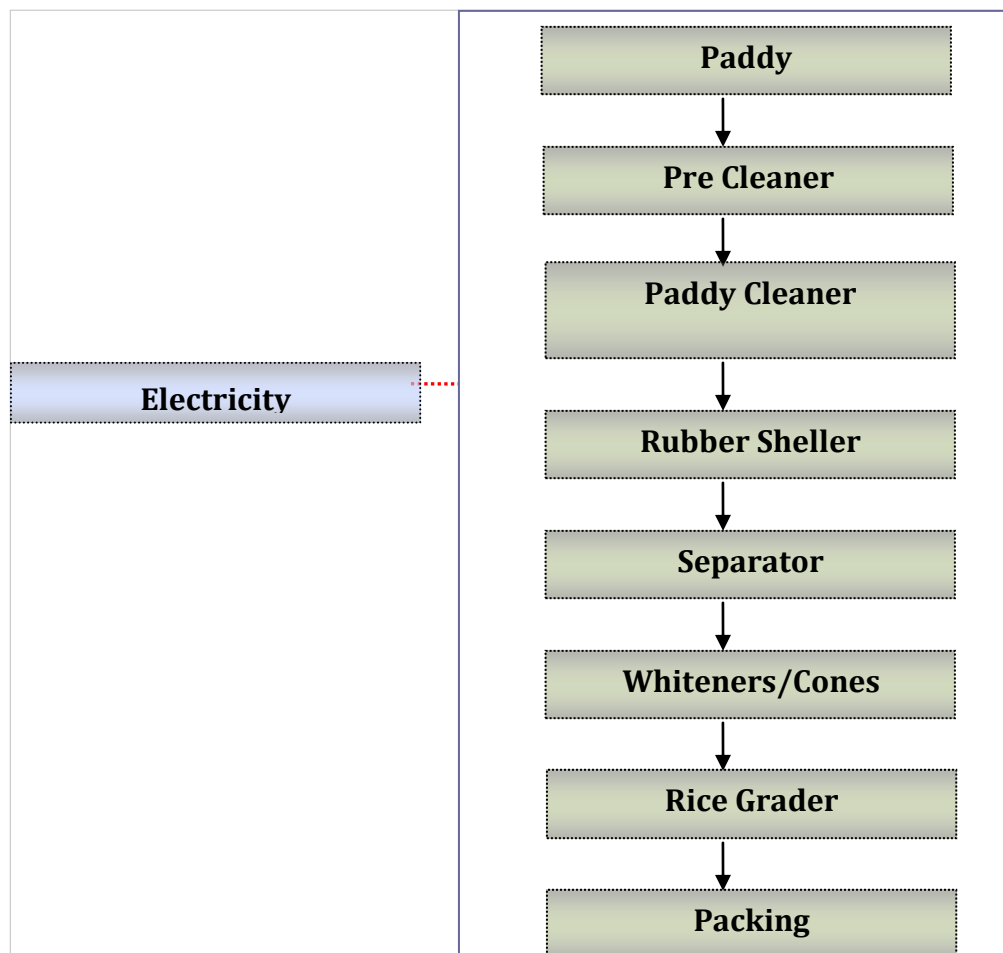

**Figure 1.1: General Process Flowchart of a rice mill is furnished below.**

## 1.2 Energy performance in existing situation

### 1.2.1 Electricity consumption of a typical unit in the cluster

The main source of energy for a typical rice milling unit in the cluster is electricity and is used for driving the prime movers of common drive shaft motor and in individual drive system like elevators, Chaluni, separator, paddy cleaners, Rubber Sheller, and whiteners/cones, drives and for lighting. The energy consumption of a typical rice production unit in the cluster is furnished in Table 1.1 below:

**Table 1.1: Energy consumption of a typical unit (M/s Sri Ganesh Rice Mill)**

S.No.	Details	Unit	Value
1	Electricity Consumption	MWh/annum	95
2	Production (Rice)	tonne/annum	6720

### 1.2.2 Average production by a typical unit in the cluster

The average production in a year in a typical rice production unit is 6720 tonne per annum.

### 1.2.3 Specific Energy Consumption

The major source of energy for paddy processing is electricity and the specific electricity consumption per ton of processing for a typical unit of having 2.0 TPH capacity is furnished in Table 1.2 below:

**Table 1.2: Specific energy consumption for a typical unit (M/s Sri Ganesh Rice Mill)**

S. No.	Type of energy	Units	Specific Energy Consumption
1	Electricity	kWh/ton of production	14.1

## 1.3 Existing technology/equipment

### 1.3.1 Description of existing technology

The main energy source for the cluster rice mill units is electricity. The electricity is supplied the state electricity board through common distribution transformers. Based on detailed energy audits conducted in various units of the cluster, the voltage supply is measured to be only 297 volts to 350 volts. About 30% of the units are facing acute low



voltage problem due to overloading of electricity board distribution transformers. Due to low voltage, the current drawn by the motors is high due to low voltage and the windings are overheated and the frequent failure of the motors is evidenced. Further, due to low voltage the power consumption of the motors is high.

As the connected load of these rice mills is low, the power is supplied through common distribution transformers and the distribution transformers installed by electricity board is of lower capacity than the demand and hence the transformers are overloaded leading to low voltage supply.

#### 1.4 Establishing the baseline for the equipment to be changed

##### 1.4.1 Electricity consumption

The electricity consumption of typical units having 2/1.5 TPH paddy processing capacity where low voltage problem is furnished below in Table 1.3 below:

**Table 1.3: Electricity consumption in three different units**

S. No	Name of the unit	Production capacity (TPH)	No of (hours/day)	No of (days /annum)	Average electricity consumption (kWh/months)	Actual Power consumption (kWh/annum)
1	M/s Sri Ganesh Rice Mill	2	14	340	7916	95,000
2	M/s Ganesh Rice Mill	1.5	10	220	2750	33,000

##### 1.4.2 Operating efficiency of the existing system

The detailed energy audits studies had been undertaken in various units of the cluster to evaluate quality of power supply in cluster units. Based on the studies undertaken, the units are facing low voltage problem due to overloading of electricity board distribution transformer. The voltage supply in the cluster is poor and is varying anywhere between 270 to 350 volts against requirement of 415 Volts plus 10% variation. Due to low voltage, the current drawn by the motors is increased and hence  $I^2R$  losses increases (no load and load losses). Further, due to over drawl of current, the motor windings gets heated up and frequent burning of the motors is common and hence drops in efficiency.

The production loss is also evident due to frequent failures of the motors and due to voltage supply, only partial equipments are operated leading to low loading of the motors hence drop in efficiency.

The above are the factors of lowering of the efficiency of the systems and hence more power consumption.

## **1.5 Barriers for adoption of new and energy efficient technology / equipment**

### **1.5.1 Technological Barriers**

The major technical barriers that prevented the implementation of the new voltage stabilizer in the cluster are:

- The major technical barrier that prevented the implementation of the voltage stabilizers/transformers in the cluster is due Lack of technical knowledge and its losses and lack of technical manpower
- Lack of technical knowledge and its losses

### **1.5.2 Financial Barrier**

- The installation of voltage stabilizers requires high initial investment. Hence, many of the owners don't show interest for implementation and operating the equipments even at low voltage.
- Lack of financial strength of the rice mill owners to invest for the technologies
- Further, the lack of awareness of the monetary losses due to the absence of voltage stabilizers is also one of the major factors for implementing the technology

*Energy Efficiency Financing Schemes such as SIDBI's, if focused on the cluster, will play a catalytic role in implementation of identified energy conservation projects & technologies.*

*The cluster has significant potential for implementing voltage stabilizer in the cluster*

### **1.5.3 Skilled manpower**

Not applicable

### **1.5.4 Other barrier(s)**

Information on the energy efficient technologies is not available among cluster unit owners.

## 2. EQUIPMENT OPTION FOR ENERGY EFFICIENCY IMPROVEMENT

### 2.1 Detailed description of technology/equipment selected

#### 2.1.1 Description of technology

The project activity is installation of voltage stabilizers and Stabilizer is the Automatic Voltage regulator. It regulates the output power. It produces the output  $230\text{ V} \pm 1\%$  (Variable 5%) or  $415 \pm 1\%$  (Variable 5%) or as per customer demand for the appliances.

Voltage stabilizers are an effective solution to voltage fluctuation problems. They are designed to current a wide range of Input Fluctuations to maintain specified output voltage. The output voltage waveform is completely distortion free and the regulation is unaffected by the load power factor.

Voltage stabilizer should have the high voltage protection. If the Input is going beyond the limit and Output is going beyond the limit in worst cases. The stabilizer should sense Input and Output condition and cutoff the output supply of the stabilizer. So In this way stabilizer protects the connected appliances.

#### 2.1.2 Technology /Equipment specifications

The detailed specifications of voltage stabilizer of 75 kVA are furnished in Table 2.1 below:

**Table 2.1: Proposed voltage stabilizer specifications**

S. No.	Parameter	Details
1	Input	340 V to 480 V AC OR As per customer demand
2	Output	$415 \pm 1\%$ (Variable 5%) OR As per customer demand
3	Capacity	Upto 100 KVA
4	Regulation	Better than $\pm 1\%$
5	Winding	Copper wound
6	Duty cycle	Continuous
7	Frequency	47 – 53 Hz
8	Waveform distortion	Nil
9	Power factor	Nil
10	Ambient	0 to $45^{\circ}\text{C}$ Max

S. No.	Parameter	Details
11	Environment	Designed for indoor tropical use
12	Mounting	Free on wheel

Further detail technical specification is given at Annexure 7.

### 2.1.3 Justification of the technology selected & its suitability

As discussed in previous sections, about 30% of the units are facing low voltage problem due to overloading of electricity board distribution transformers. Due to low voltage, frequent failures, the frequent failure of motors is very common in the units, further the current drawn by the motors is high due to low voltage and power consumption also increases.

Voltage stabilizers are an effective solution to voltage fluctuation problems and will reduce motor failures and also optimize power consumption. They are designed to current a wide range of Input Fluctuations to maintain specified output voltage. The output voltage waveform is completely distortion free and the regulation is unaffected by the load power factor.

Based on facts, the installation of voltage supply for the cluster units is a viable option for reducing motors burnt and also reducing power consumption

### 2.1.4 Superiority over existing technology/equipment

The following are the superior features of voltage stabilizers.

- Power saving
- Improves life of the equipment
- Reduces frequent burning of the motors
- Uses isolation shielding to suppress the harmonics to give quality power
- Reduces maintenance cost

### 2.1.5 Availability of the proposed technology/equipment

The voltage stabilizers suppliers are available at Bhubaneshwar, Vishakhapatnam and Vijaywada. The details of the suppliers are provided in Annexure 6.

### 2.1.6 Source of technology/equipment for the project

The source of the technology is indigenous and is locally available.

### **2.1.7 Service/technology providers**

Details of service providers had been furnished in Annexure 5.

### **2.1.8 Terms of sales of the suppliers, etc.**

The terms and conditions of the equipment supplier for supply of the voltage stabilizer are given at annexure 7.

### **2.1.9 Process down time during implementation**

The process down time for installation of voltage stabilizer is considered at two days for installation of providing electrical connections to the panel and main feeder.

## **2.2 Life cycle assessment and risks analysis**

The life of the voltage stabilizer is considered at 15 years. There is no risk involved in installation of voltage stabilizers.

## **2.3 Suitable unit/plant size the identified equipment**

Based on total connected load and actual operating at full load, the capacity of the voltage stabilizer is suitable for unit having 2.0 TPH production capacity.

### **3. ECONOMIC BENEFITS OF NEW ENERGY EFFICIENT TECHNOLOGY**

#### **3.1 Technical benefits**

##### **3.1.1 Fuel Saving**

No fuel saving is envisaged due to proposed technology

##### **3.1.2 Electricity savings**

The installation of voltage stabilizer reduces the power consumption of the unit. The power savings due to installation of project activity is estimated at 9,503 kWh per annum. Detail of saving calculation is shown in Annexure 3.

##### **3.1.2 Improvement in product quality**

There will be no significant change in the product quality due to the installation of voltage stabilizer.

##### **3.1.3 Increase in production**

The installation of voltage stabilizer increases the production capacity due to reduction in frequent breakdowns of the machines due to voltage fluctuations and motor burnt and hence there may improvement in production.

##### **3.1.4 Reduction in raw material consumption**

Not Applicable

##### **3.1.5 Reduction in other losses**

Not applicable.

#### **3.2 Monetary benefits**

The monetary benefit due to installation of voltage stabilizer is estimated at ` 0.40 lakh per annum due to reduction in electricity consumption. Details of monetary saving are given in Annexure3.

#### **3.3 Social benefits**

##### **3.3.1 Improvement in working environment in the plant**

As installation of voltage stabilizer will reduce frequent breakdowns and motor burnings and hence working environment may improve.

### **3.3.2 Improvement in skill set of workers**

The technology selected for the implementation is new and energy efficient. The technology implemented will create awareness among the workforce and improves skills of the workers.

## **3.4 Environmental benefits**

### **3.4.1 Reduction in effluent generation**

Not applicable

### **3.4.2 Reduction in GHG emission such as CO<sub>2</sub>, NO<sub>x</sub>, etc**

The major GHG emission reduction source is CO<sub>2</sub>. The technology will reduce grid electricity consumption and emission reductions are estimated at 9 tons of CO<sub>2</sub> per annum due to implementation of the project activity.

### **3.4.3 Reduction in other emissions like SO<sub>x</sub>**

No significant impact on SO<sub>x</sub> emissions.

#### 4. INSTALLATION OF NEW ENERGY EFFICIENT EQUIPMENT

##### 4.1 Cost of equipment implementation

##### 4.1.1 Cost of equipments

The total cost for voltage stabilizer is estimated ` 1.00 lakh (after discussion with technology vendor and considering the discount) as per the quotation provided in Annexure 8.

##### 4.1.2 Other costs

Cost included in cabling modification and commissioning is ` 0.05 lakh. Detail of project cost is furnished in Table 4.1 below:

**Table 4.1: Project cost**

S.No	Particular	Unit	Value
1	Voltage stabilizer	` in lakh	1.00
2	Cabling, Shaft , Modifications, Commissioning etc	` in lakh	0.05
3	Total Investment	` in lakh	1.05

#### 4.2 Arrangement of funds

##### 4.2.1 Entrepreneur's contribution

The entrepreneur's contribution is 25% of total project cost, which works out at ` 0.26 lakh.

##### 4.2.2 Loan amount

The term loan is 75% of the total project cost, which is ` 0.79 lakh.

##### 4.2.3 Terms & conditions of loan

The interest rate is considered at 10.0% which is prevailing interest rate of SIDBI for energy efficiency related projects. The loan tenure is 5 years and the moratorium period is 6 months.

#### 4.3 Financial indicators

##### 4.3.1 Cash flow analysis

Considering the above discussed assumptions, the net cash accruals starting with ` 0.24 lakh in the first year operation and increases to ` 1.00 lakh at the end of eighth year.



#### 4.3.2 Simple payback period

The total project cost of the proposed technology is ` 1.05 lakh and monetary savings due to reduction in electricity consumption is ` 0.40 lakh and the simple payback period work out to be 2.63 years.

#### 4.3.3 Net Present Value (NPV)

The Net present value of the investment at 10.0% interest rate works out to be ` 0.40 lakh.

#### 4.3.4 Internal rate of return (IRR)

The after tax Internal Rate of Return of the project works out to be 20.79%. Thus the project is financially viable.

#### 4.3.5 Return on investment (ROI)

The average return on investment of the project activity works out at 24.68%.

#### 4.4 Sensitivity analysis in realistic, pessimistic and optimistic scenarios

A sensitivity analysis has been worked out to ascertain how the project financials would behave in different situations like there is an increase in power savings or decrease. For the purpose of sensitive analysis, two scenarios are considered are.

- Increase in power savings by 5%
- Decrease in power savings by 5%

In each scenario, other inputs are assumed as constant. The financial indicators in each of the above situation are indicated along with standard indicators.

**Table 4.2: Sensitivity analysis**

<i>Particulars</i>	<i>IRR</i> %	<i>NPV</i> ` in lakh	<i>ROI</i> %	<i>DSCR</i>
Normal	20.79	0.40	24.68	1.51
5% increase in power savings	22.75	0.47	25.01	1.58
5% decrease in power savings	18.78	0.32	24.30	1.43

#### 4.5 Procurement and implementation schedule

The project is expected to be completed in 4 weeks from the date of release of purchase order. The detailed schedule of project implementation is furnished in Annexure 6.

**Annexure 1: Energy audit and base line establishment****M/s Jagates hwara Rice Mill**


<b>S.No.</b>	<b>Particulars</b>	<b>Unit</b>	<b>Value</b>
1	Voltage measured Volts (V1)	Volt	360
2	Current measured Amps (I 1)	Amp	22.4
3	Resistance R	Ohm	16.07
4	Power factor	--	0.67
5	power loss kW (P1)	kW	8.06
6	New voltage (V2)	Volt	415
7	New current Amps ( I 2)	Amp	19.43
8	power loss kW (P2)	kW	6.07
9	Net power losses reduced per hr (P)	kWh	2.00

**M/s Ganesh Rice Mill**

<b>S.No.</b>	<b>Particulars</b>	<b>Unit</b>	<b>Value</b>
1	Voltage measured Volts (V1)	Volt	360
2	Current measured Amps (I 1)	Amp	30.5
3	Resistance R	Ohm	11.80
4	power loss kW (P1)	kW	10.98
5	New voltage (V2)	Volt	415
6	New current Amps ( I 2)	Amp	26.46
6	power loss kW (P2)	kW	8.26
7	Net power losses reduced per hr (P)	kWh	2.72

**Annexure 2: Process flow diagram**


Process flow diagram is same even after implementation of proposed technology.

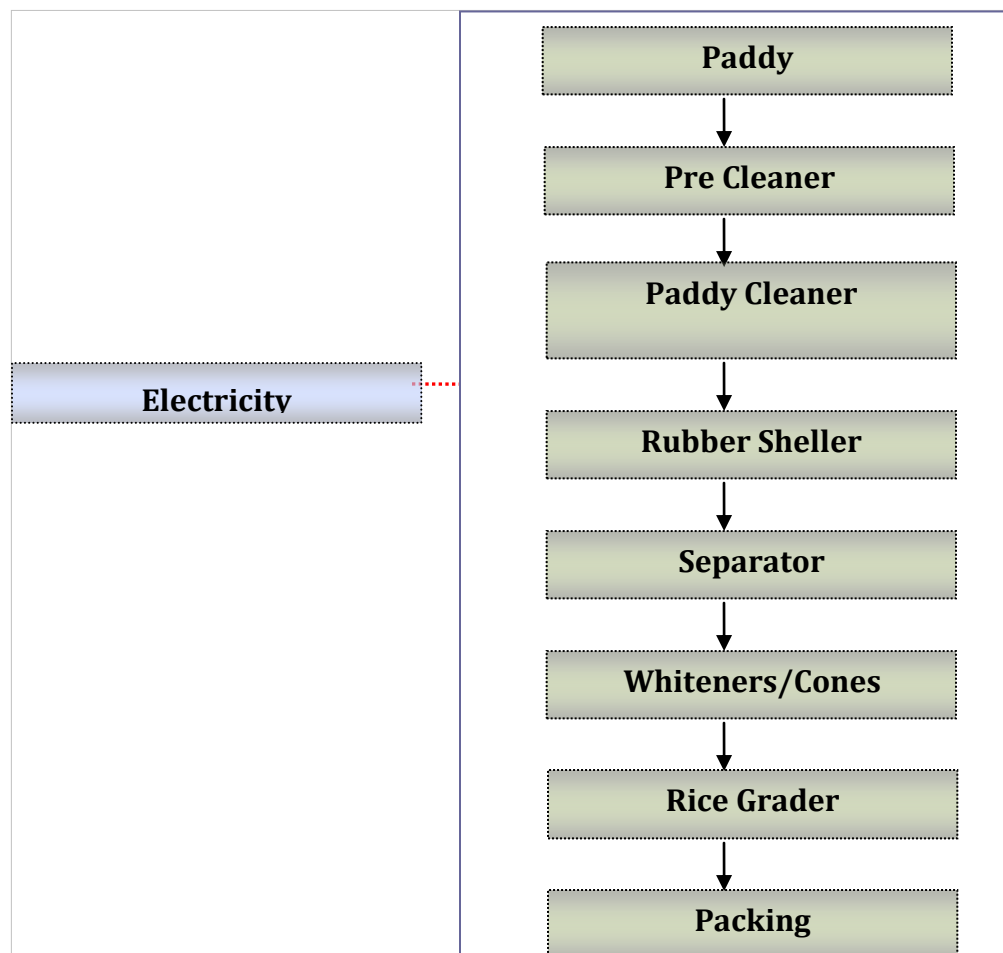

**Annexure 3: Detail technical assessment report**

<b>S.No.</b>	<b>Particulars</b>	<b>Unit</b>	<b>Value</b>
1	Voltage measured Volts (V1)	Volt	360
2	Current measured Amps (I 1)	Amp	22.4
3	Resistance R	Ohm	16.07
4	Power factor	--	0.67
5	Power loss kW (P1)	kW	8.06
6	New improved voltage (V2)	Volt	415
7	New current Amps ( I 2)	Amp	19.43
8	power loss kW (P2)	kW	6.07
9	Net power losses reduced per hr	kWh	2.00
10	Total operating hours	Hr	14
11	Total operating days	days	340
12	Total power saving	kWh	9503
13	Cost of electricity	` /kWh	4.2
14	Monetary savings per annum	`(In lakh)	0.40
15	Investment required	`(In lakh)	1.05
16	Payback period	Years	2.63

## Annexure 4 Technical design

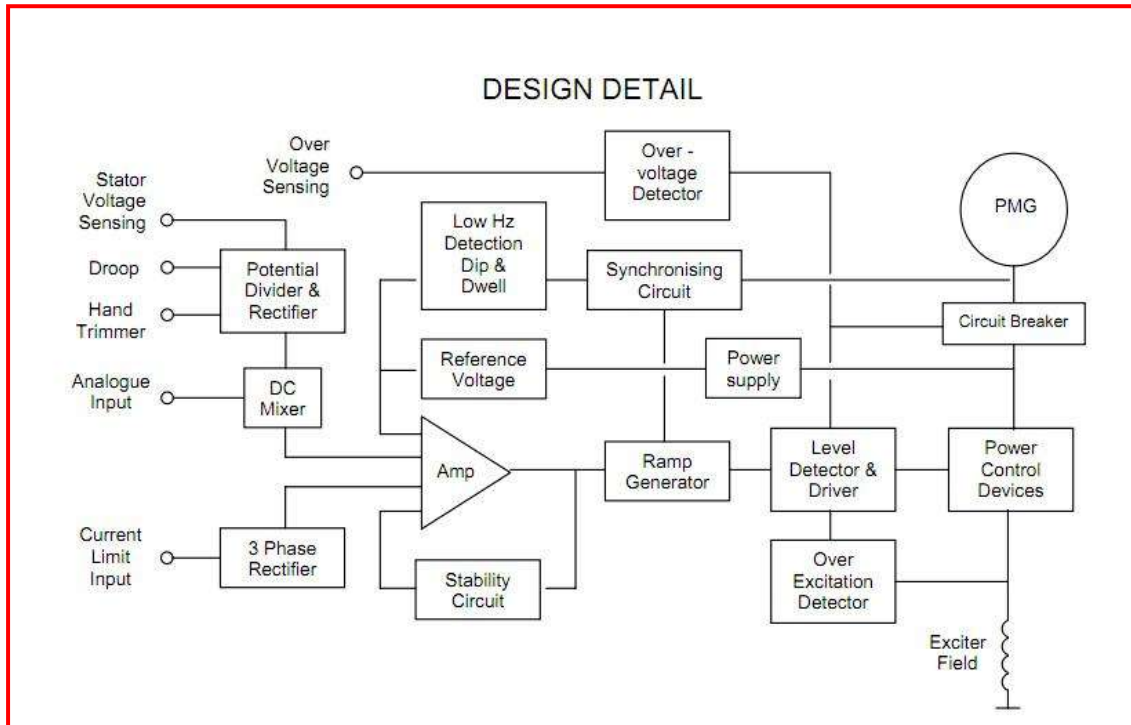

**Annexure 5: Detailed Financial Calculations & Analysis****Assumption**

<b>Name of the Technology</b>	<b>VOLTAGE STABILIZER</b>		
<b>Rated Capacity</b>	<b>75 KVA</b>		
<b>Details</b>	<b>Unit</b>	<b>Value</b>	<b>Basis</b>
Installed Capacity	KVA	75	
No of working days	Days	340	
No of operating hours	Hrs	14	
<b>Proposed Investment</b>			
Equipment cost	` (in lakh)	1.00	
Cabling, Civil works and Modification	` (in lakh)	0.05	
Total Investment	` (in lakh)	1.05	
<b>Financing pattern</b>			
Own Funds (Equity)	` (in lakh)	0.26	
Loan Funds (Term Loan)	` (in lakh)	0.79	
Loan Tenure	years	5	Assumed
Moratorium Period	Months	6	Assumed
Repayment Period	Months	66	Assumed
Interest Rate	%age	10.00%	SIDBI Lending rate
<b>Estimation of Costs</b>			
O & M Costs	% on Plant & Equip	4.00	Feasibility Study
Annual Escalation	%age	5.00	Feasibility Study
<b>Estimation of Revenue</b>			
Power saving	kWh/year	9503	
Cost	`/kWh	4.2	
St. line Depn.	%age	5.28	Indian Companies Act
IT Depreciation i.e. WDV	%age	80.00	Income Tax Rules
Income Tax rate	%age	33.99	Income Tax

**Estimation of Interest on Term Loan**

<b>(in lakh)</b>				
<b>Years</b>	<b>Opening Balance</b>	<b>Repayment</b>	<b>Closing Balance</b>	<b>Interest</b>
1	0.79	0.03	0.76	0.09
2	0.76	0.06	0.70	0.07
3	0.70	0.11	0.59	0.07
4	0.59	0.24	0.35	0.05
5	0.35	0.28	0.07	0.02
6	0.07	0.07	0.00	0.00
		0.79		

**WDV Depreciation**

₹ (in lakh)

Particulars / years	1	2
<b>Plant and Machinery</b>		
Cost	1.05	0.21
Depreciation	0.84	0.17
WDV	0.21	0.04

**Projected Profitability**

₹ (in lakh)

Particulars / Years	1	2	3	4	5	6	7	8
Fuel savings	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40
Total Revenue (A)	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40
<b>Expenses</b>								
O & M Expenses	0.04	0.04	0.05	0.05	0.05	0.05	0.06	0.06
Total Expenses (B)	0.04	0.04	0.05	0.05	0.05	0.05	0.06	0.06
PBDIT (A)-(B)	0.36	0.35	0.35	0.35	0.35	0.35	0.34	0.34
Interest	0.09	0.07	0.07	0.05	0.02	0.00	-	-
PBDT	0.27	0.28	0.29	0.30	0.32	0.34	0.34	0.34
Depreciation	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06
PBT	0.21	0.23	0.23	0.25	0.27	0.29	0.29	0.28
Income tax	-	0.04	0.10	0.10	0.11	0.12	0.12	0.12
Profit after tax (PAT)	0.21	0.19	0.13	0.14	0.16	0.17	0.17	0.17

**Computation of Tax**

₹ (in lakh)

Particulars / Years	1	2	3	4	5	6	7	8
Profit before tax	0.21	0.23	0.23	0.25	0.27	0.29	0.29	0.28
Add: Book depreciation	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06
Less: WDV depreciation	0.84	0.17	-	-	-	-	-	-
Taxable profit	(0.57)	0.11	0.29	0.30	0.32	0.34	0.34	0.34
Income Tax	-	0.04	0.10	0.10	0.11	0.12	0.12	0.12

**Projected Balance Sheet**

₹ (in lakh)

Particulars / Years	1	2	3	4	5	6	7	8
<b>Liabilities</b>								
Share Capital (D)	0.26	0.26	0.26	0.26	0.26	0.26	0.26	0.26
Reserves & Surplus (E)	0.21	0.40	0.53	0.67	0.83	1.00	1.17	1.34
Term Loans (F)	0.76	0.70	0.59	0.35	0.07	0.00	0.00	0.00
<b>Total Liabilities (D)+(E)+(F)</b>	1.23	1.36	1.39	1.29	1.17	1.27	1.44	1.61

Assets	1	2	3	4	5	6	7	8
Gross Fixed Assets	1.05	1.05	1.05	1.05	1.05	1.05	1.05	1.05
Less Accm. Depreciation	0.06	0.11	0.17	0.22	0.28	0.33	0.39	0.44
Net Fixed Assets	0.99	0.94	0.88	0.83	0.77	0.72	0.66	0.61
Cash & Bank Balance	0.24	0.42	0.50	0.46	0.39	0.55	0.78	1.00
<b>TOTAL ASSETS</b>	1.23	1.36	1.39	1.29	1.17	1.27	1.44	1.61
Net Worth	0.47	0.66	0.79	0.94	1.10	1.27	1.44	1.61
Debt Equity Ratio	2.89	2.66	2.26	1.34	0.28	0.01	0.01	0.01

**Projected Cash Flow**

₹ (in lakh)

<b>Particulars / Years</b>	<b>0</b>	<b>1</b>	<b>2</b>	<b>3</b>	<b>4</b>	<b>5</b>	<b>6</b>	<b>7</b>	<b>8</b>
<b>Sources</b>									
Share Capital	0.26	-	-	-	-	-	-	-	-
Term Loan	0.79								
Profit After tax		0.21	0.19	0.13	0.14	0.16	0.17	0.17	0.17
Depreciation		0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06
Total Sources	1.05	0.27	0.24	0.19	0.20	0.21	0.23	0.23	0.22
<b>Application</b>									
Capital Expenditure	1.05								
Repayment Of Loan	-	0.03	0.06	0.11	0.24	0.28	0.07	-	-
Total Application	1.05	0.03	0.06	0.11	0.24	0.28	0.07	-	-
Net Surplus	-	0.24	0.18	0.08	(0.04)	(0.07)	0.16	0.23	0.22
Add: Opening Balance	-	-	0.24	0.42	0.50	0.46	0.39	0.55	0.78
Closing Balance	-	0.24	0.42	0.50	0.46	0.39	0.55	0.78	1.00

**IRR**

₹ (in lakh)

<b>Particulars / months</b>	<b>0</b>	<b>1</b>	<b>2</b>	<b>3</b>	<b>4</b>	<b>5</b>	<b>6</b>	<b>7</b>	<b>8</b>
Profit after Tax		0.21	0.19	0.13	0.14	0.16	0.17	0.17	0.17
Depreciation		0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06
Interest on Term Loan		0.09	0.07	0.07	0.05	0.02	0.00	-	-
Cash outflow	(1.05)	-	-	-	-	-	-	-	-
Net Cash flow	(1.05)	0.36	0.32	0.26	0.25	0.24	0.23	0.23	0.22
IRR	20.79%								
NPV	0.40								

**Break Even Point**

₹ (in lakh)

<b>Particulars / Years</b>	<b>1</b>	<b>2</b>	<b>3</b>	<b>4</b>	<b>5</b>	<b>6</b>	<b>7</b>	<b>8</b>
<b>Variable Expenses</b>								
Oper. & Maintenance Exp (75%)	0.03	0.03	0.03	0.04	0.04	0.04	0.04	0.04
Sub Total (G)	0.03	0.03	0.03	0.04	0.04	0.04	0.04	0.04
<b>Fixed Expenses</b>								
Oper. & Maintenance Exp (25%)	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01
Interest on Term Loan	0.09	0.07	0.07	0.05	0.02	0.00	0.00	0.00
Depreciation (H)	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06
Sub Total (I)	0.16	0.14	0.13	0.12	0.09	0.07	0.07	0.07
Sales (J)	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40
Contribution (K)	0.37	0.37	0.36	0.36	0.36	0.36	0.36	0.35
Break Even Point (L= G/I)	42.83%	38.10%	36.65%	31.96%	25.61%	19.85%	19.48%	19.79%
Cash Break Even {(I)-(H)}	27.75%	22.96%	21.44%	16.67%	10.24%	4.40%	3.94%	4.16%
Break Even Sales (J)*(L)	0.17	0.15	0.15	0.13	0.10	0.08	0.08	0.08



**Return on Investment**

₹ (In lakh)

Particulars / Years	1	2	3	4	5	6	7	8	Total
Net Profit Before Taxes	0.21	0.23	0.23	0.25	0.27	0.29	0.29	0.28	2.04
Net Worth	0.47	0.66	0.79	0.94	1.10	1.27	1.44	1.61	8.27
									24.68%

**Debt Service Coverage Ratio**

₹ (In lakh)

Particulars / Years	1	2	3	4	5	6	7	8	Total
<b>Cash Inflow</b>									
Profit after Tax	0.21	0.19	0.13	0.14	0.16	0.17	0.17	0.17	1.00
Depreciation	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.06	0.33
Interest on Term Loan	0.09	0.07	0.07	0.05	0.02	0.00	0.00	0.00	0.31
Total (M)	0.36	0.32	0.26	0.25	0.24	0.23	0.23	0.22	1.64

**DEBT**

Interest on Term Loan	0.09	0.07	0.07	0.05	0.02	0.00	0.00	0.00	0.31
Repayment of Term Loan	0.03	0.06	0.11	0.24	0.28	0.07	0.00	0.00	0.79
Total (N)	0.12	0.13	0.17	0.29	0.30	0.07	0.00	0.00	1.09
	2.94	2.38	1.49	0.86	0.78	3.16	0	0	1.51
Average DSCR (M/N)	1.51								

**Annexure 6: Details of procurement and Implementation plan****Project Implementation Schedule**

S. No	Activity	Weeks			
		1	2	3	4
1	Placement of Orders for voltage stabilizer				
2	Supply of voltage stabilizer				
3	Installation of the voltage stabilizer and cabling				
4	Trial runs				

***Process down time***

The process down time for installation of voltage stabilizer is considered at two days for installation of providing electrical connections to the panel and main feeder.

**Annexure 7: Details of technology/equipment and service providers**

<b>Equipment details</b>	<b>Source of technology</b>	<b>Service/technology providers</b>
Voltage Stabilizer	Indigenous	<b>Servomax</b> Mr.T Srinivas Servomax India Limited 208, Meridian Plaza, Beside Lal Bunglow, Ameerpet, Hyderabad 500 016 Phone Nos : 040 444436666, 44436600 Email:tsrinivas@servomax.net www.servomax.net
Voltage Stabilizer	Indigenous	<b>UNIVERSAL ELECTRONICS,</b> No.14, MOSQUE STREET, ESWARAN NAGAR, ANNA SALAI, PAMMAL, CHENNAI - 600 075

## Annexure 8: Quotations or Techno-Commercial Bids



## Servomax India Limited

- ❖ Distribution Transformers - LT / HT - Up to 3Mva
- ❖ Industrial Voltage Stabilizers - L.T & H.T UPTO 5000Kva.
- ❖ Panel Boards - A.P.F.C and all types
- ❖ Isolation Transformers - up to 5000Kva
- ❖ K-1 Transformers
- ❖ K-20 Transformers - up to 2000kVA
- ❖ Surge Protection equipments
- ❖ Energy Saving Equipments and Solutions.
- ❖ Turnkey electrical solution - H.T & L.T.

All the above are backed by responsive customer support system, State of the art technology developed by R&D team and ISO quality system. This reflects our providing total solutions that enable our client to get the benefits of innovation, high savings, Quality power

### Product Recommended :

50, 75 & 100 - KVA Servo controlled Voltage Stabilizer - Air cooled	
Model :	PS 50K, 75K & 100K 3P

### Features of Servo Stabilizer

#### Protections :

- ❖ Low Voltage Protection
- ❖ High Voltage Protection
- ❖ Over load Protection
- ❖ Short Circuit Protection
- ❖ Single Phase preventer

#### High Reliability

Use solid state control circuits, No relays, No warm up time, Synchronous motor drive, Professional grade ICs and components are used

#### Trouble Free Operation

- Every unit is 'soak tested' for 48 hours
- Quick response time 10 Milli Sec ( Half a Cycle)
- All transformers are copper-wound on CR laminations and double vacuum impregnated for high efficiency

Corporate Office : #206, Meridian Plaza, Beside Lal Banglow, Ameerpet, Hyderabad Page 3



## Servomax India Limited

- Excellent regulation as high as  $\pm 0.5\%$
- Zero wave-form distortion
- Plug-in type fiberglass PCBs with gold-plated fingers for better contacts to ensure excellent reliability and minimum down-time
- Unaffected by load power factor
- No Load losses are very low
- Very wide input operating ranges
- Reset - Manual / Auto reset with time delay
- Control Switch - Phase control- Individual phase control is provided
- Provision of cabling : Input / Output cable termination with provision for fixing cable glands
- Servo Motor Drive : Rugged AC step synchronous motor
- Enclosure - IP 32
- Mounting - floor mounted / Free on wheel

### Technical Specifications:

Input Voltage	:	300-460 V 3 Ph AC
Out Put Voltage	:	415 V 3Ph AC
Line Frequency	:	47-53Hz.
Output Voltage Regulation	:	$\pm 1\%$
Type	:	Unbalanced supply and Load conditions
Efficiency	:	$\geq 98\%$
Speed of Correction	:	60 V per sec. ( Air cooled)
Wave form distortion	:	Nil
Effect of Load power factor	:	Nil
Ambient Temperature	:	0-40°C
Duty Cycle	:	Continuous
Mode of System	:	Fully Automatic / Manual
Indications on	:	Input on
		Input Low
		Input High



## Servomax India Limited

		Output On
		Output Cutoff
Controls on each Phase	:	Auto/Manual Selector Switch Increase/Decrease Selector Switch Volts adj. Potentiometer.
Metering	:	Voltmeter to read Input and Output Voltages with selector switch. Ammeter to read the Output Current in each ph with selector Switch( from 15 KVA 3 Ph onwards)
Panel Control	:	Input / Output Select Switch Auto / Manual select switch Increase / Decrease switch to control the output voltage in manual mode Volts adjust to set required output in auto mode
System Construction	:	As per IS : 9815 -1994

### Price Schedule/Scope of supply

S.No	Product Descriptions	Basin Price in Rs	Quantity in No's	Total basic Price in Rs
01	50 KVA 3 Ph SCVS	84, 000/-	01 No's	84,000.00
01	75 KVA 3 Ph SCVS	1,22,000/-	01 No's	1,22,000.00
01	100 KVA 3 Ph SCVS	1,49,000/-	01 No's	1,49,000.00

Corporate Office : #206, Meridian Plaza, Beside Lal Banglow, Ameerpet , Hyderabad Page 5



## Servomax India Limited

Note: Purchase order raised on below address

Servomax India Limited

Plot no : 16 , 17 & 18 , Ida , Phase – II ,

Cherlapally , Hyderabad-51

### Commercial Terms

PRICES QUOTED IS	: EX-WORKS BASIS,
PACKING & FORWARDING	: NIL.
DUTIES	: EXTRA AS APPLICABLE TO YOUR ACCOUNT CURRENT RATE OF EXCISE DUTY IS @ 10.3% EXTRA; EDGP SHALL BE ROVIDED.
TAXES	: EXTRA AS APPLICABLE TO YOUR ACCOUNT CURRENT RATE OF VAT @ 14.5% WILL BE CHARGED EXTRA OR 2% AGAINST FORM "C". IF ANY OTHER TAXES LIKE ENTRY TAX, OCTROI, ETC., SHALL BE EXTRA AT ACTUAL TO YOUR ACCOUNT.
DELIVERY PERIOD	: 3-4 WEEKS FROM THE DATE OF RECEIPT OF YOUR CLEAR TECHNO-COMMERCIALY PURCHASE ORDER.
WARRANTY PERIOD	: 1 YEAR FROM THE DATE OF INVOICE AGAINST ANY MANUFACTURING DEFECTS ONLY.
VALIDITY	: 30 DAYS.
PAYMENT	: 50% ADVANCE ALONG WITH PURCHASE ORDER AND BALANCE PAYMENTS AGAINST PROFORMA INVOICE
UNLOADING	: SHALL BE IN YOUR SCOPE.
Transportation	: Extra If Delivery is out of Hyderabad.

Yours Sincerely  
For Servomax India Limited

T. Srinivas

Marketing Dept

98489 10144

E mail : tsrinivas@servomax.net; Servomax\_srinivas@rediffmail.com.



### **Bureau of Energy Efficiency (BEE)**

(Ministry of Power, Government of India)

4th Floor, Sewa Bhawan, R. K. Puram, New Delhi – 110066

Ph.: +91 – 11 – 26179699 (5 Lines), Fax: +91 – 11 – 26178352

Websites: [www.bee-india.nic.in](http://www.bee-india.nic.in), [www.energymanagertraining.com](http://www.energymanagertraining.com)



### **Zenith Energy Services Pvt. Ltd**

10-5-6/B, My Home Plaza, Masab

Tank HYDERABAD, AP 500 028

Phone: 040 23376630, 31,

Fax No.040 23322517

Website: [www.zenithenergy.com](http://www.zenithenergy.com)



### **India SME Technology Services Ltd**

DFC Building, Plot No.37-38,

D-Block, Pankha Road,

Institutional Area, Janakpuri, New Delhi-110058

Tel: +91-11-28525534, Fax: +91-11-28525535

Website: [www.techsmall.com](http://www.techsmall.com)